CAYMAN ISLANDS



Development and Planning Act (2021 Revision)

BUILDING CODE REGULATIONS

(2021 Revision)

Supplement No. 6 published with Legislation Gazette No. 4 of 12th January, 2021.

PUBLISHING DETAILS

Revised under the authority of the Law Revision Act (2020 Revision).

The Building Code Regulations, 1995 made the 11th August, 1995 consolidated with Law 56 of 2020 passed 7th December, 2020 and with the —

Building Code (Amendment) Regulations, 1996 made the 13th August, 1996 Building Code (Amendment) Regulations, 2002 made the 5th July, 2002 Building Code (Amendment) Regulations, 2005 made the 22nd March, 2005. Building Code (Amendment) Regulations, 2012 made the 2nd October, 2012 Building Code (Amendment) Regulations, 2016 made the 6th December, 2016.

Consolidated and revised this 31st day of December, 2020.

Note (not forming part of these Regulations): This revision replaces the 2013 Revision which should now be discarded.



CAYMAN ISLANDS



Development and Planning Act

(2021 Revision)

BUILDING CODE REGULATIONS

(2021 Revision)

Arrangement of Regulations

| Regu | ulation | Page |
|------|--|------|
| 1. | Citation | 5 |
| 2. | Definitions | 5 |
| 3. | Application of ICC Codes to the Cayman Islands | 5 |
| 3A. | Application of Cayman Islands Building Code and Residential Code | 7 |
| 4. | Electrical | |
| 5. | Standards for single family residencies | 7 |
| 6. | Amendments to adopted codes | 7 |
| 7. | Repealed | 7 |
| 8. | Repealed | 7 |
| 9. | Repealed | 7 |
| 10. | General penalty | 7 |
| 11. | Penalty for wilful obstruction | 7 |
| 12. | Stop notices | 8 |
| 13. | Work done in contravention of Regulations or Codes | 8 |
| 13A. | Proceedings to correct or abate contravening work | 9 |
| 13B. | Penalty for contravention of the Regulations or adopted Code | 9 |
| 13C. | Proceedings by the Attorney General | 9 |
| 14. | Right of entry | 10 |
| 14A. | Identification | 10 |
| 15. | Immunity | 10 |
| SCH | EDULE 1 | 11 |
| AME | NDMENTS TO THE 2009 INTERNATIONAL BUILDING CODE | 11 |



| SCHEDULE 2 | 22 |
|---|----|
| AMENDMENTS TO THE 2009 INTERNATIONAL MECHANICAL CODE | 22 |
| SCHEDULE 3 | 25 |
| AMENDMENTS TO THE 2009 INTERNATIONAL PLUMBING CODE | 25 |
| SCHEDULE 4 | 35 |
| AMENDMENTS TO THE 2009 INTERNATIONAL FUEL AND GAS CODE | 35 |
| SCHEDULE 5 | 38 |
| AMENDMENTS TO THE 2009 INTERNATIONAL RESIDENTIAL CODE | 38 |
| SCHEDULE 6 | 66 |
| AMENDMENTS TO THE 2014 NATIONAL ELECTRICAL CODE | 66 |
| SCHEDULE 7 | 67 |
| REQUIRED PERIODIC INSPECTION AND TEST INTERVALS FOR ELEVATORS AND | |
| ESCALATORS | 67 |
| ENDNOTES | 69 |
| Table of Legislation history: | 69 |



CAYMAN ISLANDS



Development and Planning Act

(2021 Revision)

BUILDING CODE REGULATIONS

(2021 Revision)

Citation

1. These regulations may be cited as the *Building Code Regulations (2021 Revision)*.

Definitions

- **2**. In these regulations
 - "adopted Code" means a Code that applies in the Cayman Islands by virtue of regulation 3(a) to (h);
 - "Building Official" means the Director of Planning and anyone to whom the Director has delegated all or any part of the Director's authority under these Regulations.

Application of ICC Codes to the Cayman Islands

- **3**. To the extent that they are consistent with the Act and with the other laws of the Islands and subject to the exceptions, adaptation and modifications set out in Schedules 1 to 7, the provisions of the following Codes, as adopted and revised by the International Code Council (ICC) in the United States of America, shall apply as part of the law of the Islands in relation to the matters and things specified in the case of each
 - (a) the 2009 International Building Code and the 2009 International Residential Code (hereinafter referred to as the Cayman Islands Building



- Code and the Cayman Islands Residential Code) in relation to the use, occupancy, design and construction of buildings and the provision of plant, machinery, apparatus and other fittings in or in connection with buildings;
- (b) the 2009 International Plumbing Code (to be known as the Cayman Islands Plumbing Code), in relation to every plumbing installation, including the alteration, repairing or replacement thereof, and to plumbing equipment, appliances, fixtures, fittings and appurtenances except where covered in the Cayman Islands Residential Code;
- (c) the 2009 International Mechanical Code (to be known as the Cayman Islands Mechanical Code), in relation to the installation of mechanical systems including the alteration, repair and replacement thereof and to appliances, fixtures, fittings and appurtenances, including ventilation, heating, cooling, air conditioning and refrigeration systems, incinerators and other mechanical systems;
- (d) the International Fuel Gas Code 2009 (to be known as the Cayman Islands Fuel and Gas Code), in relation to the installation, operation, alteration, repairing and replacement of gas piping, gas appliances and related accessories;
- (e) the ICC-600 2008 relating to standards for Residential Construction in High-Wind Regions, specifically prescriptive methods to provide wind resistant designs and construction details for residential buildings sited in high wind regions, with wind climates of 100 to 150 mph., being a supplement to the Cayman Islands Residential Code;
- (f) the NFPA 70 National Electrical Code (NEC) 2014 ed. as amended, in relation to safe electrical design, installation, and inspection to protect people and property from electrical hazards;
- (g) the following American Society of Mechanical Engineers Safety Codes, as amended —
 - (i) Safety Code for Elevators and. Escalators ASME A17.1/CSA B44-2007, including Table 3001.7 as amended by Schedule 7;
 - (ii) Safety Code for Existing Elevators and Escalators (Includes Requirements for Electric and Hydraulic Elevators and Escalators) ASME A17.3-2008; and
 - (iii) Safety Standard for Platform Lifts and Stairway Chairlifts ASME A18.1.- 2005; and
- (h) the 2009 International Fire Code, in relation to the protection of life and property from the hazards of fire, explosion or dangerous conditions in new and existing buildings, structures and premises.



Application of Cayman Islands Building Code and Residential Code

- **3A.** (1) The Cayman Islands Building Code applies to all buildings and structures in areas where it is adopted except those covered by the Cayman Islands Residential Code.
 - (2) Those buildings and structures not covered in the Cayman Islands Building Code shall be regulated by the Cayman Islands Residential Code.

Electrical

4. The *Electricity Act* (2008 Revision) and, to the extent that it is consistent with such law, this Code shall apply to the installation of electrical systems, and to the alteration, and replacement thereof, and to electrical fixtures, fittings and appurtenances thereto.

Standards for single family residencies

- **5**. (1) All single family residences shall be constructed to meet the structural requirements of the ICC-600 (2008) Standards for Residential Construction in High-Wind Regions.
 - (2) All other aspects of construction shall comply with the Code.

Amendments to adopted codes

6. An amendment by the International Code Council, the National Fire Protection Association or the American Society of Mechanical Engineers to any of the adopted Codes shall take effect on publication in the Gazette.

Repealed

7. **Repealed** by regulation 6 of the *Building Code* (*Amendment*) *Regulations*, 2016.

Repealed

8. **Repealed** by regulation 6 of the *Building Code* (*Amendment*) *Regulations*, 2016.

Repealed

9. **Repealed** by regulation 6 of the *Building Code* (Amendment) Regulations, 2016.

General penalty

10. A person who contravenes these regulations commits an offence and is liable on summary conviction to a fine of five thousand dollars.

Penalty for wilful obstruction

11. A person who wilfully obstructs a person acting in the execution of these regulations or of an order made or issued under these regulations commits an offence and is liable on summary conviction to a fine of five thousand dollars.



Stop notices

- **12**. (1) Upon notice from the Building Official, any work on a building or structure to which these regulations or adopted Codes apply that is being done contrary to these regulations or in a dangerous or unsafe manner shall immediately cease.
 - (2) Any notice given under subregulation (1) or regulation 13 shall be in writing and shall be given to the owner of the property, to that owner's agent or to the person doing the work and shall state the conditions under which work may be resumed:

Provided that, where an emergency exists, the Building Official shall not be required to give written notice prior to stopping the work.

Work done in contravention of Regulations or Codes

- 13. (1) If any work to which the Regulations or adopted Codes apply is carried out in a dangerous or unsafe manner or in contravention of the Regulations or an adopted Code, the Building Official may, without prejudice to any right the Official may have to take proceedings under any other regulation, by notice, require the owner of the building or structure, in respect of which the work is being carried out, to do one or more of the following
 - (a) immediately cease such work;
 - (b) restrain or remove any non-compliant work or unsafe conditions;
 - (c) effect such remediation or alterations as are necessary to comply with the adopted Code and Regulations;
 - (d) if life, health and or safety risks cannot be abated through the implementation of conditions (a) to (c), pull down or remove the noncompliant work;
 - (e) recover from the person who commissioned or carried out the work the expenses incurred in implementing any of conditions (b) to (d).
 - (2) Subject to paragraph (3), a person who fails to comply with a notice served under paragraph (1) and any person who continues any work on the building to which the notice relates or on its mechanical, plumbing or building services system in contravention of such notice commits an offence and is liable on summary conviction to a fine of \$5,000 or imprisonment for 6 months, or to both.
 - (3) A person does not commit an offence under paragraph (2) by performing work as directed by the Building Official or the owner of the building or structure to remove non-compliant work or unsafe conditions.
 - (4) If an offence by a person referred to in paragraph (2) continues for more than seven days, the Building Official may issue a second notice under paragraph (1) and any person who fails to comply with that notice or who continues work in



contravention of it as described in paragraph (2), commits an offence and is liable to a fine of \$5,000 or imprisonment for 6 months, or to both.

Proceedings to correct or abate contravening work

- **13A**.(1) If a person served with a notice under regulation 13(4) fails to comply with it promptly, the Building Official shall cause legal proceedings to be instituted
 - (a) to restrain, correct or abate any contravention of the Regulations or adopted Codes; or
 - (b) to require the removal or termination of the unlawful occupancy of the building or structure to which the notice relates.
 - (2) The Summary Court may, on application by the Building Official under this regulation
 - (a) authorise the Department of Planning -
 - to restrain, correct or abate any contravention of the Regulations or adopted Codes by removal of the non-compliant work or unsafe condition; or
 - (ii) to remove or terminate the unlawful occupancy of the building or structure in contravention of this regulation; and
 - (b) order the recovery of expenses reasonably incurred under paragraph (2)(a) from the owner of the building or structure or the person who carried out the work.

Penalty for contravention of the Regulations or adopted Code

13B. Any person who erects, constructs, alters, repairs, removes, demolishes or utilises a mechanical system, or causes the same to be done, in contravention of these Regulations or an adopted Code commits an offence and is liable on summary conviction to a fine of \$5,000 or imprisonment for 6 months, or to both.

Proceedings by the Attorney General

- **13C**. The commencement of a prosecution under regulation 13 or 13B does not preclude the Attorney General from instituting legal proceedings
 - (a) to prevent unlawful construction or to restrain, correct or abate a contravention of the Regulations or an adopted Code;
 - (b) to prevent illegal occupancy of a building, structure or premises; or
 - (c) to stop an illegal act, conduct, business or utilisation of any mechanical, plumbing, electrical or building system in, on or about any premises.



Right of entry

- **14.** (1) Any person duly authorised by the Building Official may, at any reasonable time, after having given reasonable notice to the owner of that person's intention so to do, enter any land or building for the purposes of
 - (a) making any inspection in accordance with these regulations;
 - (b) ascertaining whether or not there has been a breach of these regulations;
 - (c) preventing any infringement of these regulations; or
 - (d) carrying out any other powers or duties vested in that person under these regulations requiring such entry.
 - (2) Any such entry may be made at any time if the Building Official has reasonable cause to believe that an immediate danger exists.

Identification

14A. The Building Official shall carry proper identification when inspecting buildings, structures or premises in the performance of the Official's duties under these regulations and produce it when requested to do so by the owner or occupier of the building, structure or premises.

Immunity

15. Neither the Governor, nor the Building Official, nor any person charged with the enforcement of these Regulations or the adopted Codes is liable in damages for anything done or omitted to be done in the discharge of their respective functions and duties required by law, while acting in good faith and without malice.



(regulation 3)

AMENDMENTS TO THE 2009 INTERNATIONAL BUILDING CODE

Part 1 - Amendments

| Provision of | Exception, adaptation or modification |
|-------------------------|--|
| the 2009 | |
| International | |
| Building | |
| Code affected | |
| Chapter 1 | |
| | |
| Amend Section | Delete the words "International Building Code of [NAME OF |
| 101.1 <i>Title</i> | JURISDICTION]" and substitute the words "Cayman Islands |
| | Building Code,". |
| Amend Section | In the Exception, delete the word "International" and substitute |
| 101.2 <i>Scope</i> | the words "Cayman Islands". |
| Amend Section | Delete the words "through 101.4.6 and referenced elsewhere" |
| 101.4 Referenced | and substitute the words "and 101.4.2 are for reference only and |
| Codes | not adopted in the Cayman Islands. Other codes referenced". |
| Delete Section | |
| 101.4.1 <i>Gas</i> | |
| Delete Section | |
| 101.4.2 | |
| Mechanical | |
| Delete Section | |
| 101.4.3 | |
| Plumbing | |
| Delete Section | |
| 101.4.4 <i>Property</i> | |
| Maintenance | |
| Renumber | |
| Section101.4.5 | Renumber as section 101.4.1. |
| Fire Prevention | |
| Renumber | D 1 2 101 4 2 |
| Section 101.4.6 | Renumber as section 101.4.2. |
| Energy | |



| Insert Section | "101.5 Adopted Codes. The other codes listed in Sections |
|--------------------|---|
| 101.5 Adopted | 101.5.1 through 101.5.4 and referenced elsewhere in this Code |
| Codes | shall be considered part of the requirements of this Code to the |
| Codes | prescribed extent of each such reference." |
| Toward Condition | "101.5.1 Gas. The <i>International Fuel and Gas Code</i> shall mean |
| Insert Section | |
| 101.5.1 <i>Gas</i> | the Cayman Islands Fuel and Gas Code as amended and shall |
| | apply to the installation of gas piping from the point of delivery, |
| | gas appliances and related accessories as covered in this Code. |
| | These requirements apply to gas piping systems extending from |
| | the point of delivery to the inlet connections of appliances and |
| | the installation and operation of residential and commercial gas |
| | appliances and related accessories." |
| Insert Section | "101.5.2 Mechanical. The International Mechanical Code shall |
| 101.5.2 | mean the Cayman Islands Mechanical Code as amended and |
| Mechanical | shall apply to the installation, alterations, repairs and |
| | replacement of mechanical systems, including equipment, |
| | appliances, fixtures, fittings and/or appurtenances, including |
| | ventilating, heating, cooling, air-conditioning and refrigeration |
| | systems, incinerators and other mechanical systems." |
| Insert Section | "101.5.3 Plumbing. The International Plumbing Code shall |
| 101.5.3 | mean the Cayman Islands Plumbing Code as amended and shall |
| Plumbing | apply to the installation, alteration, repair and replacement of |
| | plumbing systems, including equipment, appliances, fixtures, |
| | fittings and appurtenances, and where connected to a water or |
| | sewage system and all aspects of a medical gas system." |
| Insert Section | "101.5.4 Residential. Any reference to the <i>International</i> |
| 101.5.4 | Residential Code shall mean the Cayman Islands Residential |
| Residential | Code as amended. When uses are permitted to be constructed in |
| Trestate | accordance with the <i>International Residential Code</i> , such uses |
| | must comply with the provisions of the Cayman Islands |
| | Residential Code for that specific occupancy before exercising |
| | the option of using the <i>International Residential Code</i> ." |
| Insert Section | "101.5.5 Electrical. Any reference to NFPA 70 or Appendix K |
| 101.5.5 | shall mean the <i>National Electrical Code</i> as amended and |
| Electrical | adopted." |
| Insert Section | "101.5.6 Elevator Code. While the <i>Elevator Code</i> is the |
| 101.5.6 Elevator | adopted standard, amendments based on extracts from the |
| Code | ASME A17.1, ASME A17.3, ASME A18.1, and Chapter 30 of |
| Coue | the <i>International Building Code</i> shall also be referenced." |
| Amend Section | Delete the words "local, state or federal law" and substitute the |
| 102.2 Other laws | words "Cayman Islands laws and regulations". |
| 102.2 Other taws | words Cayman Islands laws and regulations. |



| Insert Section | "102.4.1 Amendments. Whenever amendments have been |
|-----------------------|---|
| 102.4.1 | adopted for a referenced code or standard, each reference to said |
| Amendments | code or standard shall be considered to reference the |
| Amenaments | amendments as well." |
| 4 10 .: | |
| Amend Section | Delete the words "International Property Maintenance Code" |
| 102.6 Existing | and substitute the words "Cayman Islands Building Code". |
| Structures | |
| Replace Section | Delete section 103.1 and substitute the following section - |
| 103.1 Creation | "103.1 Creation of enforcement agency. Any reference to the |
| of enforcement | "Department of Building Safety" shall mean the Department of |
| agency | Planning, which shall have primary responsibility for |
| | enforcement of this Code, as specified under the duties and |
| | powers of the Building Official. This code may be enforced by |
| | other code enforcement divisions in the Cayman Islands but |
| | authority shall be retained by the Director of Planning." |
| Amend Section | Delete the words "chief appointing authority of the jurisdiction" |
| 103.2 | and substitute the words "Building Official presiding over the |
| Appointment | authority having jurisdiction.". |
| Amend Section | Delete the words "For the maintenance of existing properties, |
| 103.3 Deputies | see the International Property Maintenance Code.". |
| Insert Section | "104.1.1 Other interpretations. Any provision or local |
| 104.1.1 <i>Other</i> | amendment marked in this Code as [F] shall be under the |
| interpretations | primary interpretation authority having jurisdiction. Any |
| interpretations | provision marked in the <i>Fire Code</i> or local amendment as [B], |
| | |
| | [FG], [M] or [P] shall be under the primary interpretation |
| A 1 C | authority of the Building Official." |
| Amend Section | Delete the words "Building Official" and substitute the words |
| 104.7 | "Department of Planning". |
| Department | |
| Records | |
| Insert Section | "104.12 Cooperation of other officials and officers. The |
| 104.12 | Building Official may request, and shall receive, the assistance |
| Cooperation of | and cooperation of other officials of the jurisdiction so far as is |
| other officials | required in the discharge of the duties required by this Code or |
| and officers | other pertinent law." |
| Delete Section | |
| 105.1.1 <i>Annual</i> | |
| Permit | |
| Delete Section | |
| 105.1.2 Annual | |
| Permit Records | |
| Amend Section | Insert the following after the word "receptacles" (under the |
| 105.2 Work | heading <i>Electrical</i>) - |
| 103.2 WUIK | neuding Dicenteur) |



| exempt from permits | "Such repairs shall not include the cutting away of any wall, partition or portion thereof, the removal or cutting of any structural beam or load-bearing support, or the removal or change of any required means of egress, or rearrangement of parts of a structure affecting the egress requirements. Nor shall ordinary repairs include addition to, alteration of, replacement or relocation of any standpipe, water supply, sewer, drainage, drain leader, gas, soil, waste, vent or similar piping, electric wiring or mechanical or other work affecting public health or general safety." |
|---------------------------|--|
| Amend Section | Insert the following sentence after the word "demonstrated" - |
| 105.3.2 <i>Time</i> | "The Building Official may also grant an extension of time, for |
| | |
| limitation of | a period of 180 days, in any case where the extension is |
| Application | necessary due to the occurrence of a national disaster." |
| Amend Section | Insert the following sentence after the word "demonstrated" - |
| 105.5 Expiration | "The Building Official may also grant an extension of time, for |
| 1 | a period of 180 days, in any case where the extension is |
| | necessary due to the occurrence of a national disaster." |
| Amend Section | Delete the words "or copy". |
| 105.7 Placement | Belete the words of copy . |
| | |
| of Permit | |
| Insert Section | "105.7.1 Responsibility. It shall be the duty of every person |
| 105.7.1 Responsibility | who performs work for the installation or repair of building, structure, electrical, gas, mechanical or plumbing systems, to which this Code is applicable, to comply with this Code." |
| Amend Section | Delete the words "where required by the statutes of the |
| 107.1 General | jurisdiction in which the project is to be constructed" and |
| 107.1 General | substitute the words "in accordance with the requirements of this |
| | Code and the <i>Cayman Islands Residential Code</i> and where |
| | |
| | required by the laws and regulations governing the Cayman |
| | Islands or as required by the Building Official.". |
| Amend Section 107.2.1 | Insert the words "drawn to scale," immediately before the word "dimensioned". |
| Information on | |
| Construction | |
| Documents | |
| Replace Section | Delete section 107.2.2 and substitute the following - |
| 107.2.2 Fire | "107.2.2 Fire protection system shop drawings. Shop |
| protection | drawings, calculations and manufacturers' specifications for the |
| system shop | fire protection system(s) shall be submitted to the authority |
| drawings | having jurisdiction, to indicate conformity with this Code and |
| | the construction documents and shall be approved by that |
| | authority prior to the start of system installation. Shop drawings |
| | a a and a start of by stern instantation, briop drawings |



| | shall contain all information as required by the referenced installation standards in Chapter 9. All fire alarm and fire sprinkler systems shall require the engineer or contractor on record to submit to the authority having jurisdiction the form 'letter of acceptance' upon completion and installation of such systems." |
|------------------|---|
| Insert Section | "107.2.6 Manufacturers' installation instructions. |
| 107.2.6 | Manufacturers' installation instructions, as required by this |
| Manufacturer's | Code, shall be available on the job site at the time of inspection." |
| installation | |
| instructions | |
| Delete Section | |
| 107.3.2 Previous | |
| Approvals | |
| Amend Section | Insert before the full stop the words ", in accordance with the |
| 109.1 Payment | Development and Planning Act (2021 Revision) and |
| of Fees | Development and Planning Regulations (2021 Revision) Fee |
| | Schedules". |
| Amend Section | Delete the words "applicable governing authority" and |
| 109.2 Schedule | substitute the words "Development and Planning Act (2021 |
| of Permit Fees | Revision) and Development and Planning Regulations (2021Revision) Fee Schedules". |
| Delete Section | |
| 109.3 Building | |
| Permit | |
| Valuations | |
| Amend Section | Delete the words "shall be subject to a fee established by the |
| 109.4 Work | Building Official that shall be in addition to the required permit |
| commencing | fees" and substitute the words "commits an offence under the |
| before permit | Development and Planning Act (2021 Revision) or the |
| issuance | Development and Planning Regulations (2021 Revision) and |
| | shall be subject to a fine and or after-the-fact fees as required by |
| | law". |
| Delete Section | |
| 109.6 Refunds | |
| Insert Section | "109.6 Administrative Hold. Any administrative discrepancy |
| 109.6 | including but not limited to, delinquency in payments, returned |
| Administrative | cheques, failure to pay for re-inspection, investigation or |
| Hold | registration fees, and failure to keep any registration, insurance |
| | or bond up-to-date, may result in a hold being placed on the |
| | issuance of permits and performance of inspections of existing |
| | permits until the administrative discrepancy is corrected. For the |
| | purpose of this section, the term "up-to-date" shall mean that |



| | whenever any registration, insurance or bond is required by these or any other regulations in order to obtain a permit under this Code, the registration, insurance or bond shall be maintained current and in effect." |
|-----------------------|--|
| Insert Section | "110.1.1 Permit Card. Work requiring a permit shall not be |
| 110.1.1 <i>Permit</i> | commenced until the permit holder or an agent of the permit |
| Card | holder shall have made available the permit card such as to allow |
| Cara | the Building Official to conveniently make the required entries |
| | |
| | thereon regarding inspection of the work. This card shall be |
| | maintained available by the permit holder until final approval |
| | has been granted by the Building Official." |
| Delete Section | |
| 110.3.7 Energy | |
| Efficiency | |
| Inspections | |
| Chapter 3 | |
| Insert Section | "310.3 Fire Department Vehicle Access. All RI and R2 |
| 310.3 | occupancies three (3) or more stories in height shall provide |
| Fire Department | open space of at least twenty (20) feet wide along three (3) sides |
| Vehicle Access | of the Building." |
| Chapter 5 | |
| Amend Section | Amend Table 503 Allowable Building Heights and Areas - |
| 503 General | (a) by deleting the word "UL" under A for TYPE 1, |
| Building Height | and substituting the number "130"; |
| and Area | (b) by deleting the number "160" under B for TYPE |
| Limitations | 1 and substituting the number "130"; |
| | (c) by adding the superscript "e" at the end of the |
| | words "TYPE 1"; and |
| | (d) by inserting the following footnote after Footnote |
| | "d." - |
| | "e. No building or buildings shall exceed 130 feet in |
| | height or 10 stories.". |
| | (See amended Table 503 in Part 2 of this Schedule). |
| Chapter 9 | |
| Insert Section [F] | "[F] 901.5.1 On-site Water Supply. An on-site supply of water |
| 901.5.1 Onsite | equal to the hydraulically calculated sprinkler demand or |
| Water Supply | standpipe whichever is greater shall be provided for a minimum |
| | duration of 45 minutes." |
| Amend Section | Delete item 4 and substitute the following: |
| [F] 903.2.7 | "4. Group M occupancy exceeding 5,000 square feet (464m2) is |
| Group M | used for the display and sale of upholstered furniture or |
| - · · · · · · · · · | mattresses.". |
| | L |



| A 1 C | D 1 4 41 1 60 1 00 122 1 1 4'4-4 41 1 |
|------------------------|--|
| Amend Section | Delete the words "fire code official" and substitute the words |
| [F] 904.2 Where | "Building Official". |
| required | |
| Chapter 11 | |
| Insert Section | "1101.2.1 Type A and Type B units. Type A and Type B units |
| 1101.2.1 <i>Type A</i> | per ANSI 117.1 chapter 10 are not adopted." |
| and Type B units | |
| Replace Section | Delete section 1107.6 and substitute the following section - |
| 1107.6 Group R | "1107.6 Group R. Accessible units, shall be provided in Group |
| | R occupancies in accordance with Sections 1107.6.1 and |
| | 1107.6.4.". |
| Replace Section | Delete section 1107.6.1 and substitute the following section - |
| 1107.6.1 <i>Group</i> | "1107.6.1 Group R-1. Accessible units shall be provided in |
| R-1 | Group R-1 occupancies in accordance with Sections |
| | 1107.6.1.1.". |
| Replace Section | Delete section 1107.6.1 and substitute the following section - |
| 1107.6.4 <i>Group</i> | "1107.6.4 Group R-4. Accessible units shall be provided in |
| R-4 | Group R-1 occupancies in accordance with Sections |
| | 1107.6.4.1.". |
| Delete Section | |
| 1107.6.1.2 <i>Type</i> | |
| B units | |
| Delete Section | |
| 1107.6.4.2 <i>Type</i> | |
| B units | |
| Delete Section | |
| 1107.6.2 <i>Group</i> | |
| R-2 | |
| Delete Section | |
| 1107.6.3 <i>Group</i> | |
| R-3 | |
| Delete Section | |
| 1107.7 General | |
| exceptions | |
| Chapter 15 | |
| Replace Section | Delete section 1507.2.3 and substitute the following section - |
| 1507.2.3 | "1507.2.3 Underlayment. Underlayment shall be self-adhering |
| | polymer-modified bitumen sheet and shall comply with ASTM |
| Underlayment | 1970.". |
| Replace Section | Delete 1507.2.1 and substitute the following section - |
| 1507.3.3 | "1507.3.3 Underlayment. Underlayment shall be self- |
| Underlayment | adhering polymer-modified bitumen sheet and shall |
| Onaeriaymeni | aunering polymer-mounted bitumen sheet and shall |
| | comply with ASTM 1970.". |



| Replace Section 1507.6.3 | Delete section 1507.6.3 and substitute the following section - "1507.6.3 Underlayment. Underlayment shall be self- |
|--------------------------|--|
| Underlayment | adhering polymer-modified bitumen sheet and shall comply with ASTM 1970.". |
| Replace Section | Delete section 1507.7.3 and substitute the following section - |
| 1507.7.3 | "1507.7.3 Underlayment. Underlayment shall be self- |
| Underlayment | adhering polymer-modified bitumen sheet and shall comply with ASTM 1970.". |
| Replace Section | Delete section 1508.3 and substitute the following section - |
| 1508.8.3 | "1507.8.3 Underlayment. Underlayment shall be self- |
| Underlayment | adhering polymer-modified bitumen sheet and shall comply with ASTM 1970.". |
| Chapter 16 | |
| Delete Section | |
| 1608 Snow | |
| Loads | |
| Replace Figures | Delete all Basic Wind Speed Figures and substitute Figure 1609 |
| in Section 1609 | Basic Wind Speed (3 sec gust) Cayman Islands Map from Part 2 |
| Basic Wind | of the Schedule. |
| Speed | |
| Replace Figures | Delete all 100 Year, 1 Hour Rainfall figures and substitute |
| in Section | Figure 1611.1 100 year 1 Hour Rainfall (inches) Cayman |
| 1611.1 Design | Islands Map from Part 2 of the Schedule. |
| rain loads | |
| Amend Section | In the definition of "Flood Hazard Area Subject to High |
| 1612.2 | Velocity Wave Action" delete the words "Flood Insurance Rate |
| Definitions | Map (FIRM) or other" and in the definition of "Flood Insurance |
| | Rate Map (FIRM)" delete the words "the Federal Emergency |
| | Management Agency (FEMA) has" and substitute the word |
| | "are". |
| Delete Section 1612.3 | |
| Establishment of | |
| Flood Hazard | |
| Areas | |
| Delete Section | |
| 1613.5 Seismic | |
| ground motion | |
| values | |
| Chapter 23 | |
| Amend Section | Delete the words "geographical areas" and substitute the words |
| 2304.11.6 | "the Cayman Islands". |



| Termite | |
|------------------|---|
| Protection | |
| Replace Table | Delete Table 2308.10.2 2 Ceiling Joist Spans For Common |
| 2308.10.2 | Lumber Species and substitute Tables 2308.10.2 (1) and (2) |
| Ceiling Joist | Ceiling Joist Spans for Common Lumber Species from Part 2 of |
| Spans for | the Schedule. |
| Common Lumber | |
| Species | |
| Replace Table | Delete Table 2308.10.3 Rafter Spans for Common Lumber |
| 2308.10.3 | Species and substitute Tables 2308.10.3(1) and (2) Rafter Spans |
| Rafter Spans for | for Common Lumber Species from Part 2 of the Schedule. |
| common lumber | |
| species | |
| Chapter 26 | |
| Replace Figure | Delete Figure 2603.8 Termite Infestation Probability Map and |
| 2603.8 | substitute Figure 2603.8 Cayman Islands Termite Infestation |
| Termite | Probability Map from Part 2 of the Schedule. |
| Infestation | , , |
| Probability Map | |
| Chapter 30 | |
| Insert Section | "3001.7 Periodic inspection frequency. All existing elevator |
| 3001.7 Periodic | installations shall be inspected at intervals as indicated on Table |
| inspection | 3001.7." |
| frequency | |
| Chapter 34 | |
| Delete section | |
| 3412.2 | |
| Applicability | |
| Appendices | |
| Delete Appendix | |
| A Employee | |
| qualifications | |
| Delete Appendix | |
| B Board of | |
| appeals | |
| Delete Appendix | |
| D Fire districts | |
| Delete Appendix | |
| E Supplementary | |
| accessibility | |
| requirements | |



| Delete Appendix | |
|-------------------|--|
| G Flood resistant | |
| construction | |
| Delete Appendix | |
| J Grading | |
| Delete Appendix | |
| K Administrative | |
| provisions | |



Part 2 – Attachments

TABLE 503 ALLOWABLE BUILDING HEIGHTS AND AREAS^a

Building height limitations shown in feet above grade plane. Story limitations shown as stories above grade plane.

Building area limitations shown in square feet, as determined by the definition of "Area, building," per story

| | | TYPE OF CONSTRUCTION | | | | | | | | |
|-------|-------------------------|----------------------|-----|-----------|----|-----|----------|----|--------|----|
| | | TYPI | ΕΙ° | TYPE II T | | TYI | TYPE III | | TYPE V | |
| | | A | В | A | В | A | В | НТ | A | В |
| | HEIGHT (FEET) | 130 | 130 | 65 | 55 | 65 | 55 | 65 | 50 | 40 |
| GROUP | STORIES (S) AREA (A) | | | | | | | | | |

For SI: 1 foot = 304.8 mm, 1 square foot = 0.0929 m2

A = building area per story, S = stories above grade plane,

UL = Unlimited, NP = Not permitted. a. See the following sections for general exceptions to Table 503:

- Section 504.2, Allowable building height and story increase due to automatic sprinkler system installation.
- 2. Section 506.2, Allowable building area increase due to street frontage.
- 3. Section 506.3, Allowable building area increase due to automatic sprinkler system installation.
- 4. Section 507, Unlimited area buildings.
 - b. For open parking structures, see Section 406.3.
 - c. For private garages, see Section 406.1.
 - d. See Section 415.5 for limitations.
 - e. No building or buildings shall exceed 130 feet in height nor 10 stories



(regulation 3)

AMENDMENTS TO THE 2009 INTERNATIONAL MECHANICAL CODE

| Provision of the | Exceptions, adaptations and modifications |
|----------------------------------|--|
| 2009 | |
| International | |
| Mechanical | |
| Code affected | |
| Preface | Under the section "Adoption", delete the words "and in the |
| | sample ordinance" and the sentence following those words. |
| Ordinance | Delete this section. |
| Chapter 1 | |
| Amend Section 101.1 <i>Title</i> | Insert the words "the Cayman Islands" before the words "Mechanical Code" and delete the words "of [NAME OF JURISDICTION]". |
| Amend Section | Delete the words "local, state or federal law" and substitute the |
| 102.10 Other Laws | words "Cayman Islands laws or regulations". |
| Amend Section | "103.1 General. Any reference to the "Department of |
| 103.1 General | Mechanical Inspection" shall mean the Department of Planning, |
| | which shall have primary responsibility for enforcement of this |
| | Code, as specified under the duties and powers of the Building |
| | Official. This code may be enforced by other code enforcement |
| | divisions in the Cayman Islands but authority shall be retained |
| | by the Director of Planning." |
| Amend Section | Delete the words "chief appointing authority of the jurisdiction" |
| 103.2 Appointment | and substitute the words "Director of Planning, presiding over |
| | the authority having jurisdiction". |
| Delete Section 103.4 | |
| Liability | |
| Delete Section 104.4 | |
| Right of Entry | |
| Delete Section 104.5 | |
| Identification | |
| Delete Section 104.6 | |
| Notices and Orders | |
| Amend Section | Delete the words "code official" and substitute the words |
| 104.7 Department | "Department of Planning". |
| Records | |



| Amend Section | Delete the words "and ordinances". |
|----------------------|---|
| 106.4 <i>Permit</i> | Delete the words "in Section 106.5" and substitute the words |
| Issuance | "the Development and Planning Act (2021 Revision) and |
| | Development and Planning Regulations (2021 Revision)". |
| Amend 106.4.1 | Delete the words "stamped "APPROVED" and substitute the |
| Approved | words "stamped "REVIEWED FOR CODE COMPLIANCE"". |
| Construction | • |
| Documents | |
| Amend Section | Delete the word "one-half". |
| 106.4.3 Expiration | |
| Amend Section | Delete the words "one half the amount required for a new permit |
| 106.4.4 Extensions | for such work" and substitute the words "as stipulated in the |
| | Development and Planning Act (2021 Revision) and |
| | Development and Planning Regulations (2021 Revision)". |
| Amend Section | Delete the words "Code official for a period of not less than 180 |
| 106.4.6 Retention of | days from the date of completion of the permitted work or as |
| Construction | required by state or local laws" and substitute the words |
| Documents | "Department of Planning as required by the Development and |
| | Planning Act (2021 Revision) and Development and Planning |
| | Regulations (2021Revision)". |
| Amend 106.5 Fees | Delete the words "Section 106.5.2" and substitute the words |
| 11110110 100.5 1 005 | "the Development and Planning Act (2021 Revision) and |
| | Development and Planning Regulations (2021 Revision)". |
| Amend 106.5.1 Work | Delete the words "100 percent of the usual permit fee in addition |
| commencing before | to the required permit fees" and substitute the words "the fees |
| Permit Issuance | set out in the Development and Planning Act (2021 Revision) |
| 1 Cimii Issuance | and Development and Planning Regulations (2021 Revision)". |
| Delete 106.5.2 Fee | and Development and Flamming Regulations (2021 Revision). |
| Schedule | |
| Delete 106.5.3 Fee | |
| Refunds | |
| Delete 108.1 | |
| Unlawful Acts | |
| Delete Section 108.3 | |
| Prosecution of | |
| violation | |
| Delete Section 108.4 | |
| Violation penalties | |
| Delete Section 108.5 | |
| Stop Work orders | |
| Delete 108.6 | |
| Abatement of | |
| violation | |
| violation | |



| Delete Section 109 | |
|---------------------|--|
| Means of Appeal | |
| Appendices | |
| Delete Appendix A | |
| Combustion Air | |
| Openings and | |
| Chimney Connector | |
| Pass throughs | |
| Delete Appendix B | |
| Recommended | |
| Permit Fee Schedule | |



(regulation 3)

AMENDMENTS TO THE 2009 INTERNATIONAL PLUMBING CODE

Part 1 – Amendments

| Provision of | Exceptions, adaptations and modifications |
|---|--|
| the 2009 | * / * |
| International | |
| Plumbing | |
| Code | |
| affected | |
| Chapter 1 | |
| Amend section 101.1 <i>Title</i> | Delete the words "International Plumbing Code of [NAME OF JURISDICTION]" and substitute the words "Cayman Islands Plumbing Code,". |
| Delete Section 104.4 Right of Entry | |
| Delete Section | |
| 104.5 | |
| Identification | |
| Delete Section | |
| 104.6 Notices | |
| and Orders | |
| Amend Section 104.7 | Delete the words "code official" and substitute the words "Department of Planning". |
| Department | |
| Records | |
| Amend Section | Delete the words "and ordinances". |
| 106.5 Permit | Delete the words "in Section 106.6" and substitute the words "the |
| Issuance | Development and Planning Act (2021 Revision) and Development and Planning Regulations (2021 Revision)". |
| Amend Section | Delete the words "stamped "APPROVED" and substitute the |
| 106.5.1 | words "stamped "REVIEWED FOR CODE COMPLIANCE"". |
| Approved | |
| Construction | |
| Documents | |



| Amend Section | Delete the word "one-half". |
|----------------|---|
| 106.5.3 | |
| Expiration | |
| Amend Section | Delete the words "one half the amount required for a new permit |
| 106.5.4 | for such work" and substitute the words "as stipulated in the |
| Extensions | Development and Planning Act (2021 Revision) and |
| | Development and Planning Regulations (2021 Revision)". |
| Amend Section | Delete the words "code official for a period of not less than 180 |
| 106.5.6 | days from the date of completion of the permitted work or as |
| Retention of | required by state or local laws" and substitute the words |
| Construction | "Department of Planning as required by the Development and |
| Documents | Planning Act (2021 Revision) and Development and Planning |
| | Regulations (2021 Revision)". |
| Amend 106.6 | Delete the words "Section 106.6.2" and substitute the words "the |
| Fees | Development and Planning Act (2021 Revision) and |
| | Development and Planning Regulations (2021 Revision)". |
| Amend 106.6 .1 | Delete the words "100 percent of the usual permit fee in addition |
| Work | to the required permit fees." and substitute the words "the fees as |
| commencing | stated in the Development and Planning Act (2021 Revision) and |
| before Permit | Development and Planning Regulations (2021 Revision)". |
| Issuance | |
| Delete 106.6.2 | |
| Fee Schedule | |
| Delete 106.6.3 | |
| Fee Refunds | |
| Delete 108.4 | |
| Violation | |
| penalties | |
| Delete 108.5 | |
| Stop Work | |
| Orders | |
| Delete Section | |
| 109 Means of | |
| Appeal | |
| Chapter 3 | |
| Delete section | |
| 305.6 Freezing | |
| Delete section | |
| 305.6.1 | |
| Sewer depth | |
| Amend Section | Insert the words "parking lots" after the word "driveways". |
| 305.9 | Delete the words "in an approved manner" and substitute the |
| Protection of | following words - |



| | Los | | | |
|------------------------|--|--|--|--|
| components of | "by - | | | |
| plumbing | (a) burying the crown of pipe a minimum of twelve | | | |
| system | inches (12") below grade in accordance with | | | |
| | section 306.3 Backfilling; or | | | |
| | (b) in situations where it is not possible to bury the | | | |
| | pipe, protecting the pipe with a sleeve as per | | | |
| | Section 305.5 and covering it in a minimum of | | | |
| | two inches of concrete". | | | |
| Insert Section | "305.10 Minimum piping cover. All piping shall be | | | |
| 305.10 | continuously supported on earth free from hard debris. The crown | | | |
| Minimum | of the piping shall have six inches (6") minimum clean tamped | | | |
| piping cover | earth cover or the pipe shall be continuously sleeved as per | | | |
| p.pg cover | section 305.5". | | | |
| Amend Section | Delete the words "the working pressure of the system; or, for | | | |
| 312.5 Water | piping systems other than plastic, by an air test of not less than | | | |
| supply system | 50 psi (344 kPa)" and substitute the words "100 psi (688 kPa), or, | | | |
| test | where applicable at the discretion of the Building Official by an | | | |
| iesi | | | | |
| | air test of not less than 100 psi (688 kPa)". | | | |
| | Delete the words "15 minutes" and substitute the words "24 | | | |
| 10 .: | hours". | | | |
| Amend Section | Delete the words "outlet to an approved place of disposal" and | | | |
| [M] 314.2.1 | substitute the words "outlet to the sanitary or public sewer or to | | | |
| Condensate | an approved place of disposal, as approved by the sewage | | | |
| Disposal | authority or the Water Authority as applicable". | | | |
| Chapter 4 | | | | |
| Amend Section | Insert at the end of the section the following - | | | |
| 412.3 Size of | "Exception: Floor drains shall be provided in all public | | | |
| Floor Drains | restrooms. Such drains shall have a minimum outlet of not | | | |
| | less than three inches (3")(76 mm) in diameter and shall | | | |
| | have trap primers.". | | | |
| Chapter 6 | | | | |
| Replace Section | "608.6.1 Private water supplies. Where cross connections | | | |
| 608.6.1 <i>Private</i> | between private and public sources of water are utilised, an | | | |
| water supplies | approved back flow preventer shall be required at the water | | | |
| | service pipe on the customer side of the water meter, in addition | | | |
| | to the backflow preventer required by the public utility." | | | |
| Amend Table | Delete the distance value for "seepage pits" and substitute "100". | | | |
| 608.17.1 | Delete the distance value "septic tanks" and substitute "50". | | | |
| Distance from | Insert under the heading in alphabetical order under the heading | | | |
| contamination | "Source of Contamination" the words "effluent disposal well" | | | |
| to private water | and "storm water disposal wells" and insert a distance value of | | | |
| supplies and | "100" for each. | | | |



| pump suction | (See Table 608.17.1 Distance From Contamination to |
|----------------------|--|
| lines | <i>Private Water Supplies and Pump Suction Lines</i> in Part 2 of the |
| | Schedule) |
| Delete Section | |
| 608.17.3 Depth | |
| Insert Section | "608.17.9 Cisterns used for potable water supply. The cistern |
| 608.17.9 | shall be constructed in such a manner to provide safeguards from |
| Cisterns used | contamination. In the event the bottom of the cistern is 12" or |
| for potable | higher above the local groundwater table, the inside of the cistern |
| water supply | shall be single rendered with approved waterproof material. In |
| | the event the bottom of the cistern is less than 12" above the local |
| | groundwater table, the inside and outside shall be double |
| | rendered with approved waterproof material. Installation of any |
| | part of the building drain and building sewer anywhere above the |
| | cistern or within 12" of the vertical sides or the bottom of the |
| | cistern is prohibited. The outlet, overflow and manhole of the |
| | cistern shall be located at least 12" above ground level and shall |
| | have adequate protection from the ingress of floodwater, storm water and any other items that render the water unsuitable for |
| | potable use." |
| Amend Section | Delete the words "New or repaired potable water systems" and |
| 610.1 General | substitute the words "New, modified or repaired potable water |
| 010.1 General | systems for educational occupancies, food establishments and |
| | medical facilities". |
| | Delete the words "that prescribed by the health authority or water |
| | purveyor having jurisdiction or, in the absence of a prescribed |
| | method,". |
| Chapter 7 | |
| Amend Section | Insert at the end of the section the following sentence - |
| 701.5 <i>Damage</i> | "The disposal of hazardous materials not covered in Section |
| to drainage | 1003 shall be prohibited in accordance with section 48 of |
| system or public | the current revision of the Water Authority Act.". |
| sewer | |
| Chapter 9 | |
| Amend Section | Delete the words "7 feet (2134 mm)" and substitute the words "7 |
| 904.1 <i>Roof</i> | feet, 6 inches (2286.5 mm)". |
| extension | |
| Amend Section | Insert before the full stop the words "and shall be designed and |
| 917.1 <i>General</i> | listed for corrosive or coastal environments". |
| Chapter 10 | D 1 4 4 4 5 5 1 6 1 5 4 5 4 7 7 8 9 9 |
| Amend Section | Delete the words "and automatic grease removal devices" from |
| 1003.3.1 | the section title and the section. |
| Grease | Delete the words "or automatic grease removal devices". |



| interceptors and | Delete the word "wok" and substitute the word "work". | | | |
|------------------------|---|--|--|--|
| automatic | | | | |
| grease removal | | | | |
| devices | | | | |
| required | | | | |
| Amend Section | Delete the words "and automatic grease removal devices" in the | | | |
| 1003.3.3 | section title. | | | |
| Grease | Delete the words "or an automatic grease removal device". | | | |
| interceptors and | | | | |
| automatic | | | | |
| grease removal | | | | |
| devices not | | | | |
| required | | | | |
| Replace Section | Article I. Delete section 1003.3.4 and substitute the following | | | |
| 1003.3.4 | section - | | | |
| Grease | "1003.3.4 Grease interceptors. Grease interceptors shall be | | | |
| interceptors and | water-tight tanks designed and constructed to withstand | | | |
| automatic | anticipated loads. Grease interceptors shall have not less than two | | | |
| grease removal | compartments and a minimum volume of 600 US gallons. The | | | |
| devices | design and dimensions shall be in accordance with Figure | | | |
| | 1003.3.4. Access covers shall be watertight to prevent infiltration | | | |
| | of storm water." | | | |
| Insert Figure | Insert Figure 1003.3.4 Commercial Grease Interceptor from Part | | | |
| 1003.3.4 | 2 of this Schedule. | | | |
| Commercial | | | | |
| Grease | | | | |
| Interceptor | | | | |
| Replace Section | Delete section 1003.3.4.1 and substitute the following section - | | | |
| 1003.3.4.1 | "1003.3.4.1 Grease Interceptor sizing. Grease interceptors | | | |
| Grease | shall be sized by the Water Authority. | | | |
| Interceptor | Exception: Indoor under-sink or in-floor grease interceptors | | | |
| capacity | are permitted in buildings constructed before 2001 or where | | | |
| cupacity | approved by the code official. Indoor grease interceptors | | | |
| | shall comply with the requirements of Sections 1003.3.1 | | | |
| | through 1003.3.3 and Sections 1003.3.4.2 through | | | |
| | 1003.3.4.4." | | | |
| Replace Section | Delete section 1003.3.4.2 and substitute the following section - | | | |
| 1003.3.4.2 <i>Rate</i> | "1003.3.4.2 Indoor grease Interceptors Indoor grease | | | |
| of flow controls | interceptors shall be sized in accordance with PDI G101, ASME | | | |
| of flow controls | A112.14.3 Appendix A, or ASME A1 12.14.4. Indoor grease | | | |
| | interceptors shall be designed and tested in accordance with PDI | | | |
| | | | | |
| I | G101, ASME A112.14.3 or ASME A112.14.4. Indoor grease | | | |



| | interceptors shall be installed in accordance with manufacturer's |
|--|--|
| | instructions." |
| Insert Section | "1003.3.4.3 Indoor grease interceptor capacity. Indoor grease |
| 1003.3.4.3 | interceptors shall have the grease retention capacity indicated in |
| Indoor grease | Table 1003.3.4.3 for the flow-through rates indicated." |
| interceptor | |
| capacity | |
| Insert Section | "1003.3.4.4 Rate of flow controls. Indoor grease interceptors |
| 1003.3.4.4 Rate | shall be equipped with devices to control the rate of water flow |
| of flow controls | so that the water flow does not exceed the rated flow. The flow- |
| | control device shall be vented and terminate not less than 6 inches |
| | (152 mm) above the flood rim level or be installed in accordance |
| | with the manufacturer's instructions." |
| Delete Section | |
| 1003.3.5 | |
| Automatic | |
| Grease | |
| Removal | |
| Devices | |
| Amend Section | Insert the word "oil" after the words "pits,". |
| 1003.4 Oil | Delete the words "the building drainage system or other point of |
| separators | disposal" and substitute the words "an effluent disposal well.". |
| required | Delete the last sentence of the Section containing the Exception. |
| Amend Section | Delete the word "receptacle" and substitute the word "separator". |
| 1003.4.1 | |
| Separation of | |
| liquids | |
| Replace section | "1003.4.2.1 General design. For general design of conventional |
| 1003.4.2.1 | oil separators, see figure 1003.4.2.1." |
| General Design | Insert Figure 1003.4.2.1 and footnotes from Part 2 of the |
| Requirements | Schedule. |
| Insert Section | "1003.4.2.1.1 Manufactured coalescing oil separators. |
| 1003.4.2.1.1 | Manufactured coalescing oil separators will be approved based |
| Manufactured | on review of manufacturer's design guidelines for the proposed |
| coalescing oil | application." |
| separators | |
| Chapter 11 | |
| Amend Section | Delete the words ", or a combined sewer system,". |
| 1101.2 | • |
| Where required | |
| Delete Section | |
| Defett Section | |
| Separation of liquids Replace section 1003.4.2.1 General Design Requirements Insert Section 1003.4.2.1.1 Manufactured coalescing oil separators Chapter 11 Amend Section 1101.2 Where required | oil separators, see figure 1003.4.2.1." Insert Figure 1003.4.2.1 and footnotes from Part 2 of the Schedule. "1003.4.2.1.1 Manufactured coalescing oil separators. Manufactured coalescing oil separators will be approved based on review of manufacturer's design guidelines for the proposed |



| Delete Section | |
|----------------|--|
| 1104.2 | |
| Combining | |
| storm with | |
| sanitary | |
| drainage | |
| Delete Section | |
| 1108 Combined | |
| Sanitary and | |
| Storm System | |
| Appendices | |
| Delete | |
| Appendix A | |
| Plumbing | |
| Permit Fee | |
| Schedule | |
| Delete | |
| Appendix B | |
| Rates of | |
| Rainfall for | |
| Various Cities | |
| Delete | |
| Appendix D | |
| Degree Day | |
| and Design | |
| Temperatures | |

Part 2 - Attachments TABLE 608.17.1 DISTANCE FROM CONTAMINATION TO PRIVATE WATER SUPPLIES AND PUMP SUCTION LINES

| SOURCE OF CONTAMINATION | DISTANCE (feet) |
|---|-----------------|
| Barnyard | 100 |
| Farm silo | 25 |
| Pasture | 100 |
| Pumphouse floor drain of cast iron draining to ground surface | 2 |
| Seepage pits | 100 |
| Septic tank | 50 |




| Sewer | 10 |
|----------------------------|-----|
| Subsurface disposal fields | 50 |
| Subsurface pits | 50 |
| Storm water disposal wells | 100 |
| Effluent disposal well | 100 |


For SI: 1 foot = 304.8 mm.



Figure 1003.3.4

COMMERCIAL GREASE INTERCEPTOR

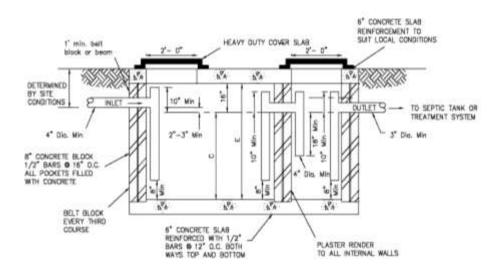

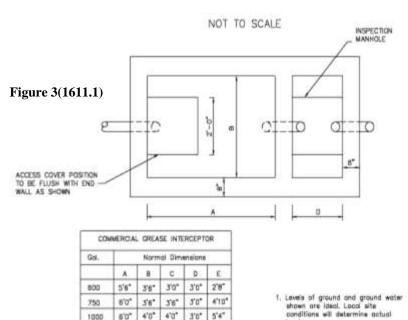

3'0"




1000

1250

5'0"

6'6" 4'0" 4'5" 3'6" 5'10" levels.

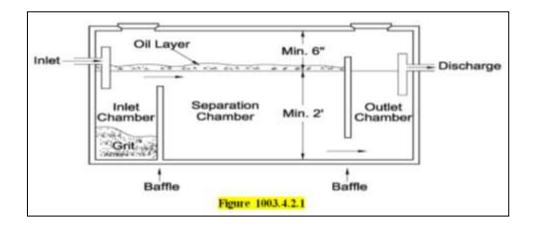

Notes:

- 1. Separators shall be designed with inlet, outlet and baffle devices to distribute flow and retain oil and grit in the compartments.
- 2. Length to width ratio 2:1
- 3. Width to depth ratio 2:1
- 4. Depth a minimum of 2.5 feet
- 5. Access covers shall be watertight to prevent infiltration of storm water.



(regulation 3)

AMENDMENTS TO THE 2009 INTERNATIONAL FUEL AND GAS CODE

| Provision of | Exceptions, adaptations and modifications |
|-------------------------------|---|
| the 2009 | |
| International | |
| Fuel and | |
| Gas Code | |
| affected | |
| Preface | Under the section "Adoption", delete the words "and in the |
| | sample ordinance" and the sentence following those words. |
| Ordinance | Delete this section. |
| Chapter 1 | |
| Amend Section | Delete the words "Fuel and Gas Code of [NAME OF] |
| 101.1 <i>Title</i> | JURISDICTION]" and substitute the words "Cayman Islands |
| | Fuel and Gas Code". |
| Amend Section | Delete the words "local, state or federal law" and substitute the |
| 102.10 Other | words "Cayman Islands laws or regulations". |
| laws | |
| Replace Section 103.1 General | "103.1 General. Any reference to the "Department of Inspection" shall mean the Department of Planning, which shall have primary responsibility for enforcement of this Code, as |
| | specified under the duties and powers of the <i>code official</i> . This code may be enforced by other code enforcement divisions in the Cayman Islands but authority shall be retained by the Director of Planning." |
| Amend Section | Delete the words "chief appointing authority of the jurisdiction" |
| 103.2 | and substitute the words "Director of Planning, presiding over the |
| Appointment | authority having jurisdiction". |
| Amend Section | Delete the words "code official" and substitute the words |
| 104.7 | "Department of Planning". |
| Department | z-tp |
| Records | |
| Amend Section | Delete the words "state law" and substitute the words "these |
| 106.3.1 | codes or Cayman Islands laws and regulations". |
| Construction | Insert the words ", dimensioned" immediately after the word |
| documents | "scale". |



| Amend Section 106.5.1 | Delete the word "stamped "APPROVED" and substitute the words "stamped "REVIEWED FOR CODE COMPLIANCE". |
|--|--|
| Approved Construction Documents | |
| Amend Section R106.3.2 Timeline of Application | Insert the following sentence after the word "demonstrated" - "The Building Official may also grant an extension of time, for a period of 180 days, in any case where the extension is necessary due to the occurrence of a national disaster.". |
| Insert Section R106.5.3 Expiration of Permit | "R106.5.3 Expiration of Permit. Every permit issued shall become invalid unless the work on the site authorised by such permit is commenced within 180 days after its issuance, or if the work authorised on the site by such permits suspended or abandoned for a period of 180 days after the time the work is commenced. The <i>code official</i> is authorised to grant, in writing, one or more extensions of time, for periods not more than 90 days each. The extension shall be requested in writing and justifiable cause demonstrated. Exception: An extension of time, for a further period of 180 days, may be allowed for the permit in any case where the extension is necessary due to the occurrence of a national disaster." |
| Amend Section R106.5.6 Retention of construction documents | Delete the words "Code official for a period of not less than 180 days from the date of completion of the permitted work or as required by state or local laws" and substitute the words "Department of Planning as required by the Development and Planning Act (2021 Revision) and Development and Planning Regulations (2021 Revision)". |
| Amend Section 106.5.8 Posting of permit | Delete the words "or a copy". |
| Delete Section 106.6 Payment of fees | Delete the words "in section 106.6.2" and substitute the words "under the Development and Planning Act and Development and Planning Regulations (2021 Revision) Fee Schedules". |
| Delete Section 106.6.1 | |
| Delete Section 106.6. Fee schedule | Delete the words "as indicated in the following schedule. [JURISDICTION TO INSERT APPROPRIATE SCHEDULE]" and substitute "in accordance with the Development and Planning Act (2021 Revision) and Development and Planning Regulations (2021 Revision) Fee Schedules". |



| Delete Section | |
|----------------|--|
| 106.6.3 Fee | |
| refunds | |



SCHEDULE 5

(regulation 3)

AMENDMENTS TO THE 2009 INTERNATIONAL RESIDENTIAL CODE

Part 1 - Amendments

| Provision of the 2009 | Exceptions, adaptations and modifications |
|--------------------------------------|--|
| International | |
| Residential Code | |
| affected | |
| Preface | Under the section "Adoption", delete the words "and in the sample ordinance" and the sentence following those words. Insert at the end of the Preface the following charts from Part 2 of the Schedule - "Residential Construction Requirements and the relevant ICC 600 Section Table 1"; "Residential Construction Requirements and the relevant ICC 600 Section Table 2"; and "Code Reference Chart for the International Residential Code". |
| Ordinance | Delete this section. |
| Chapter 1 | |
| Amend Section R101.1 Title | Delete the words "[NAME OF JURISDICTION]" and substitute the words "the <i>Cayman Islands Building Code</i> ,". |
| Insert Section R101.4 Adopted Codes | "101.5 Adopted Codes. The other codes listed in Sections R101.4.1 through R101.4.6 and referenced elsewhere in this Code shall be considered part of the requirements of this Code to the prescribed extent of each such reference." |
| Insert Section R101.4.1 Gas | "R101.4.1 Gas. The International Fuel and Gas Code shall mean the Cayman Islands Fuel and Gas Code as amended and shall apply to the installation of gas piping from the point of delivery, gas appliances and related accessories as covered in this Code. These requirements apply to gas piping systems extending from the point of delivery to the inlet connections of appliances and the |



| | installation and operation of residential and commercial | | | | |
|-------------------------|---|--|--|--|--|
| | gas appliances and related accessories." | | | | |
| Insert Section R101.4.2 | "R101.4.2 Mechanical. The International Mechanical Code shall mean the Cayman Islands Mechanical Code | | | | |
| Mechanical | as amended and shall apply to the installation, alterations, | | | | |
| | == : | | | | |
| | | | | | |
| | including equipment, appliances, fixtures, fittings and/or | | | | |
| | appurtenances, including ventilating, heating, cooling, | | | | |
| | air-conditioning and refrigeration systems, incinerators | | | | |
| | and other energy-related systems." | | | | |
| Insert Section R101.4.3 | "R101.4.3 Plumbing. The International Plumbing Code | | | | |
| Plumbing | shall mean the Cayman Islands Plumbing Code as | | | | |
| | amended shall apply to the installation, alteration, repair | | | | |
| | and replacement of plumbing systems, including | | | | |
| | equipment, appliances, fixtures, fittings and | | | | |
| | appurtenances, and where connected to a water or sewage | | | | |
| | system and all aspects of a medical gas system." | | | | |
| Insert Section R101.4.4 | "R101.4.4 Residential. Any reference to the | | | | |
| Residential | International Residential Code shall mean the Cayman | | | | |
| | Islands Residential Code as amended. When uses are | | | | |
| | permitted to be constructed in accordance with the | | | | |
| | International Residential Code, such uses must comply | | | | |
| | with the provisions of this Code for that specific | | | | |
| | occupancy before exercising the option of using the | | | | |
| | International Residential Code." | | | | |
| Insert Section R101.4.5 | "R101.4.5 Electrical. Any reference to NFPA 70 or | | | | |
| Electrical | Appendix K shall mean the National Electrical Code as | | | | |
| | amended and adopted." | | | | |
| Insert Section R101.4.6 | "R101.4.6 Elevator Code. While the <i>Elevator Code</i> is | | | | |
| Elevator Code | the adopted standard, amendments based on extracts | | | | |
| | from the ASME A17.1, ASME A18.1, and Chapter 30 of | | | | |
| | the International Building Code shall also be | | | | |
| | referenced." | | | | |
| Amend Section R102.2 | Delete the words "local, state or federal law" and | | | | |
| Other laws | substitute the words "Cayman Islands laws or | | | | |
| | regulations". | | | | |
| Insert Section R102.4.1 | "R102.4.1 Amendments. Whenever amendments have | | | | |
| Amendments | been adopted for the referenced codes and standards, | | | | |
| | each reference to said code and standard shall be | | | | |
| | considered to reference the amendments as well." | | | | |
| Amend Section R102.7 | Delete the words "International Property Maintenance | | | | |
| Existing Structures | Code" and substitute the words "The Cayman Islands | | | | |
| 0 | Building Code.". | | | | |





| Amend Section 105.6 Suspension or Revocation | Delete the words "ordinance or regulation" and substitute the words "laws and regulations of the Cayman Islands". |
|--|---|
| Amend Section R105.7 Placement of Permit | Delete the words "or copy". |
| Amend Section R106.1 Submittal Documents | Delete the words "statutes of the jurisdiction in which the project is to be constructed" and substitute the words "where required by the Laws and Regulations of the Cayman Islands". |
| Amend Section R106.1.1 Information on Construction Documents | Insert the words "drawn to scale, dimensioned and" immediately before the word "drawn". |
| Amend Section R106.5 Retention of construction documents | Delete the words "code official for a period of not less than 180 days from the date of completion of the permitted work or as required by state or local laws" and substitute the words "Department of Planning as required by the Development and Planning Act (2021 Revision) and Development and Planning Regulations (2021 Revision)". |
| Insert Section R107.5 Tents, canopies and other membrane structures | "R107.5 Tents, canopies and other membrane structures. Tents, canopies and other membrane structures shall be regulated by the <i>International Fire Code</i> ." |
| Amend Section R108.2 Schedule Fees | Delete the words "applicable governing authority" and substitute the words "Development and Planning Act (2021 Revision) and Development and Planning Regulations (2021 Revision) Fee Schedules.". |
| Delete Section R108.3 Building Permit Valuations | |
| Delete Section R108.5 Refunds | |
| Amend Section R108.6 Work commencing before permit issuance | Delete the words "shall be subject to a fee established by the <i>applicable governing authority</i> that shall be in addition to the required permit fees" and substitute the words "commits an offence under the Development and Planning Act (2021 Revision) or the Development and Planning Regulations (2021 Revision) and shall be |



| | subject to a fine and or after-the-fact fees as required by law". | | | | | |
|-------------------------|---|--|--|--|--|--|
| Chapter 3 | | | | | | |
| Amend TABLE R301.2 | Delete the following words - | | | | | |
| (1) | "Ground snow load"; | | | | | |
| | "weathering"; | | | | | |
| | "frost line depth"; | | | | | |
| | "winter design temperature"; | | | | | |
| | "ice barrier underlayment"; | | | | | |
| | "air freezing index"; | | | | | |
| | "mean annual temperature". | | | | | |
| | Delete footnotes a through k to the Table and substitute | | | | | |
| | the following - | | | | | |
| | "a. The finish floor level should be at least five feet | | | | | |
| | (5') above mean sea level, [i.e. two feet (2') above | | | | | |
| | mean sea level] or as otherwise determined by the | | | | | |
| | Central Planning Authority.". | | | | | |
| Replace Figures | Delete all Figures R301.2(2) Seismic Design Categories | | | | | |
| R301.2(2) Seismic | Sites Class D and substitute Figure 301.2.2(2) Cayman | | | | | |
| Design Categories Sites | Islands: Seismic Design Category from Part 2 of the | | | | | |
| Class D | Schedule. | | | | | |
| Delete Figure R301.2(3) | | | | | | |
| Weathering Probability | | | | | | |
| Map for Concrete | | | | | | |
| Replace all Figures | Delete all Figures R301.2(4) Basic Wind Speed for 50- | | | | | |
| R301.2(4) Basic Wind | Year Mean Recurrence Interval and footnotes and | | | | | |
| Speed for 50-Year Mean | substitute Figure 301.2(4) Cayman Islands Basic Wind | | | | | |
| Recurrence Interval | Speeds for 50-Year Recurrence Interval from Part 2 of | | | | | |
| | this Schedule and the following footnotes - | | | | | |
| | "For SI: 1 foot = 304.8 mm , 1 mile per hour = 0.447 | | | | | |
| | m/s. | | | | | |
| | a. Values are nominal design 3-second gust wind | | | | | |
| | speeds in miles per hour at 33 feet above ground | | | | | |
| | for Exposure C category. | | | | | |
| | b. Linear interpolation between wind contours is | | | | | |
| | permitted. | | | | | |



| | c. Islands and coastal areas outside the last contour shall use the last wind speed contour of the coastal area. | | | | |
|--------------------------|--|--|--|--|--|
| | d. Mountainous terrain, gorges, ocean promontories | | | | |
| | and special wind regions shall be examined for | | | | |
| | unusual wind conditions.". | | | | |
| Delete Figure 301.2.5(5) | unusuur wind conditions. | | | | |
| Ground Snow Loads, pg, | | | | | |
| for the United States | | | | | |
| Replace Figure | Delete Figure R301.2(6) Termite Infestation Probability | | | | |
| R301.2(6)Termite | · · · · · · · · · · · · · · · · · · · | | | | |
| Infestation Probability | Map and substitute Figure R301.2(6) Cayman Islands | | | | |
| Мар | Termite Infestation Probability from Part 2 of the | | | | |
| A | Schedule. | | | | |
| Amend Section R302.2 | Delete the words "1-hour fire-resistance-rated" and | | | | |
| Townhouses | substitute the words "2-hour fire resistance-rated". | | | | |
| Amend Section R313.1 | Delete the words "be installed in townhouses" and | | | | |
| Townhouse automatic | substitute the words ", when installed in townhouses, be | | | | |
| fire sprinkler systems | installed in accordance with section R313.1.1". | | | | |
| | Delete the last sentence beginning with the word | | | | |
| | "Exception". | | | | |
| Amend Section R313.1.1 | Insert the words "NFPA 13D or" after the words "in | | | | |
| Design and installation | accordance with". | | | | |
| Replace Section R313.2 | Delete section R313.2 and substitute the following – | | | | |
| One-and two-family | "R313.2 One- and two-family dwellings automatic | | | | |
| dwellings automatic fire | fire systems When installed in one- and two-family | | | | |
| systems | dwellings, an automatic residential fire sprinkler system | | | | |
| | shall be installed in accordance with section R313.2.1." | | | | |
| Amend Section R313.2.1 | Delete the words "P2904 and NFPA 13D" and substitute | | | | |
| Design and Installation | the words "NFPA 13D or P2904". | | | | |
| Amend Section R315.1 | Insert the words "and Liquefied Petroleum Gas" after the | | | | |
| Carbon Monoxide | word "Monoxide". | | | | |
| Alarms | | | | | |
| Insert Section R315.1.2 | "R315.1.2 Carbon Monoxide Alarms. Where fuel | | | | |
| Carbon Monoxide | burning appliances are located within the dwelling unit, | | | | |
| Alarms | carbon monoxide alarms complying with UL2034 shall | | | | |



| | <u> </u> | | | | | |
|---|--|--|--|--|--|--|
| | be installed in accordance with this Code and the | | | | | |
| | manufacture's installation instructions. A combination | | | | | |
| | smoke/carbon monoxide alarm shall be permitted." | | | | | |
| Insert Section R315.4 | "R315.4 Liquefied Petroleum Gas (LPG) Alarms LPG | | | | | |
| Liquefied Petroleum Gas | leak detection alarms shall be provided in all areas where | | | | | |
| (LPG) Alarms | fuel fired appliances are installed or where LPG supply | | | | | |
| | lines are provided to the kitchen area. LPG leak detectors | | | | | |
| | shall be listed as complying with UL 1484 and shall be | | | | | |
| | installed in accordance with this Code and the | | | | | |
| | | | | | | |
| | manufacturer's installation instructions." | | | | | |
| Delete Section R319.1 | | | | | | |
| Site Address | | | | | | |
| Delete Section R320 | | | | | | |
| Accessibility | | | | | | |
| Delete Section R321.3 | | | | | | |
| Accessibility | | | | | | |
| Delete Section R322.1 | | | | | | |
| General | | | | | | |
| Delete Section R322.1.1 | | | | | | |
| Alternative Provisions | | | | | | |
| Delete Section R322.1.4 | | | | | | |
| Establishing the design | | | | | | |
| flood elevation | | | | | | |
| Delete Section | | | | | | |
| R322.1.4.1 | | | | | | |
| Determination of design | | | | | | |
| flood Elevations | | | | | | |
| Delete Section R322.2 | | | | | | |
| Flood Hazard Areas | | | | | | |
| (including A zones) Delete Section R322.3 | | | | | | |
| | | | | | | |
| Coastal high-hazard areas (including V zones) | | | | | | |
| Chapter 4 | | | | | | |
| Amend Section R403.1.4 | Delete the words "Sections R403.1.4.1 through" | | | | | |
| Minimum depth | immediately after the words "conform to" and substitute | | | | | |
| тинин шери | the word "Section". | | | | | |
| | the word Section . | | | | | |



| Delete Section | |
|--|---|
| R403.1.4.1 Frost | |
| Protection | |
| Chapter 5 | |
| Replace Tables | Delete Tables 502.3.1(1) and (2) Floor Joist Spans for |
| 502.3.1.(1) and (2) <i>Floor</i> | common Lumber Species and substitute Table |
| Joist Spans for common | R502.3.1.(1) Floor Joist Spans for Common Lumber |
| Lumber Species | Species from Part 2 of the Schedule. |
| Chapter 8 | |
| Replace Table R802.4.(1) | Delete Table R802.4.(1) Ceiling Joist Spans for common |
| Ceiling Joist Spans for | Lumber Species and substitute Table R802.4.(1) Ceiling |
| common Lumber Species | Joist Spans for Common Lumber Species from Part 2 of |
| | the Schedule. |
| Replace Table R802.4.(2) | Delete Table R802.4.(2) Ceiling Joist Spans for common |
| Ceiling Joist Spans for | Lumber Species and substitute Table R802.4.(2) Ceiling |
| common Lumber Species | Joist Spans for common Lumber Species from Part 2 of |
| | the Schedule. |
| Replace Table R802.5.1 | Delete Table R802.5.1(1) Rafter Spans for Common |
| (1) Rafter Spans for | Lumber Species and substitute Table R802.5.1 (1) Rafter |
| Common Lumber Species | Spans for Common Lumber Species from Part 2 of the |
| | Schedule. |
| Replace Table R802.5.1 | Delete Table R802.5.1(2) Rafter Spans for Common |
| (2) Rafter Spans for | Lumber Species and substitute Table R802.5.1 (2) Rafter |
| Common Lumber Species | Spans for Common Lumber Species from Part 2 of the |
| | Schedule. |
| Delete Tables R802.5.1 | |
| (3) to R802.5.1 (8) Rafter | |
| Spans for Common | |
| Lumber Species - Ground | |
| Snow loads | |
| Chapter 9 | |
| Delete Section | |
| R905.2.7.1 Ice barrier | |
| Delete Section | |
| R905.4.3.1 <i>Ice barrier</i> Delete Section | |
| R905.5.3.1 Ice barrier | |
| Delete Section | |
| R905.6.3.1 Ice barrier | |
| Delete Section | |
| R905.8.3.1 Ice barrier | |



| Chapter 11 | |
|--------------------------------------|---|
| Delete Chapter 11 | |
| Energy Efficiency | |
| Chapter 15 | |
| Amend Section | Delete the words "25 feet (7620 mm)" and substitute the |
| M1502.4.4.1 Specified | words "35 feet (10668 mm)". |
| Length | |
| Chapter 24 | |
| Amend Section | Insert the following at the end of the Section - |
| G2406.2(303.3) | "6. Liquefied Petroleum (LPG) appliances shall not |
| Prohibited locations | be installed in unventilated spaces that would cause |
| | ponding or retention of gas.". |
| Chapter 34 | |
| Delete Chapter 34 | |
| General Requirements | |
| Appendices | |
| Delete Appendix D | |
| Recommended Procedure | |
| for Safety Inspection of | |
| an Existing Appliance | |
| Installation | |
| Delete Appendix F Radon | |
| Control Methods | |
| Delete Appendix I | |
| Swimming Pools, Spas | |
| and Hot Tubs | |
| Delete Appendix J Patio | |
| Covers | |
| | |
| Delete Appendix K Sound Transmission | |
| | |
| Delete Appendix L | |
| Permit Fees | |
| Delete Appendix N | |
| Venting Methods | |
| Delete Appendix O Gray | |
| Water Recycling Systems | |
| Delete Appendix Q | |
| ICC International | |
| Residential Code | |
| Electrical Provisions/ | |
| Liectrical Frovisions/ | |



| National Electrical Code | |
|--------------------------|--|
| Cross Reference | |



Part 2 – Attachments

RESIDENTIAL CONSTRUCTION REQUIREMENTS AND THE RELEVANT ICC 600 SECTION TABLE 1 $\,$

| Masonry Block | 201-202 | 203 | 205 | 204 | 206-207 | Chapter 5 | Chapter 6 | Chapter 7 |
|------------------|---------|-----------|-----|-----|---------|-----------|-----------|-----------|
| Construction | | | | | | | | |
| Insulated | | 203 | 209 | 204 | | Chapter 5 | Chapter 6 | Chapter 7 |
| Concrete | | | | | | | | |
| Form (ICF) | | | | | | | | |
| Construction, | | | | | | | | |
| Concrete Flat | | | | | | | | |
| Panel Walls | | | | | | | | |
| Light-Frame | 301-304 | 305 & | 307 | | | Chapter 5 | Chapter 6 | Chapter 7 |
| Wood | | Chapter 4 | | | | _ | _ | _ |
| Construction | | _ | | | | | | |
| Light-frame | 301-304 | 305 & | | | | Chapter 5 | Chapter 6 | Chapter 7 |
| Cold-formed | | Chapter 4 | | | | _ | _ | - |
| Steel | | - | | | | | | |
| Construction | | | | | | | | |



RESIDENTIAL CONSTRUCTION REQUIREMENTS AND THE RELEVANT ICC 600 SECTION TABLE 2

| | Masonry Block | ICF and Concrete Flat Panel Walls | Wood | CFS |
|------------------------------|--|--|----------------------------------|---------------------------------------|
| Foundation | ICC-600 Sec 203 | ICC-600 Sec 203 | ICC-600 Sec 305 IRC Ch 4 | ICC-600 Sec 305 IRC Ch 4 |
| Wall | ICC-600 Sec 205 | ICC-600 Sec 209 | WFCM | AISI S230 |
| Floor | ICC-600 Sec 204 | ICC-600 Sec 204 | WFCM | AISI S230 |
| Roof | ICC-600 Sec 206/207 ICC-600 Ch 5 AF&PA Span Tables IRC Table R503.2.1.1(1) IRC Table R602.3(1) IRC Ch 8 & 9 | WFCM or AISI S230 ICC-600 Ch 5 IRC Ch 9 | WFCM ICC-600 Ch 5 IRC Ch 9 | AISI S230 ICC-600 Ch 5 IRC Ch 9 |
| Fenestration | ICC-600 Chapter 6 | ICC-600 Chapter 6 | ICC-600 Chapter 6 | ICC-600 Chapter 6 |
| Exterior Wall Covering | ICC-600 Chapter 7 | ICC-600 Chapter 7 | ICC-600 Chapter 7 | ICC-600 Chapter 7 |

References:

2008 ICC- 600 Standard for Residential Construction in High-Wind Regions

2009 International Residential Code (IRC)

2001 AF&PA Wood Frame Construction Manual (WFCM)


2007 AISI S230 Standard for Cold-Formed Steel Framing – Prescriptive Method for One and Two Family Dwellings (AISI S230)

2005 AF&PA Joists and Rafters Span Tables (download gratis from awc.org)

150mph, SDC D₂ Caribbean Basin Builder's Guide based on the 2001 WFCM (download for free from awc.org)



ICC-600 Appendix C contains design checklists which may assist in determining the appropriate code reference for prescribing a given element.

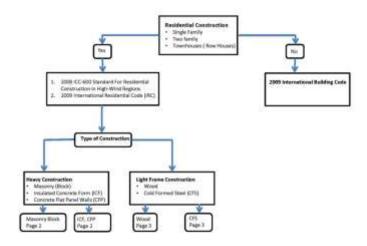

Code Reference Chart for the international Recidential Code


| | TABLE | R301.2(1) | | | | | | | | |
|--|-------------|-----------------------|--------------------------------------|----------------------|--|--|--|--|--|--|
| CLIMATIC AND GEOGRAPHIC DESIGN CRITERIA | | | | | | | | | | |
| Wind Design Seismic Subject to Flood Damage from | | | | | | | | | | |
| Willd | Design | Design | Damage from Termites ^a | Hazards ^d | | | | | | |
| Speed (mph) ^b | Topographic | Category ^c | Termite | | | | | | | |
| | effects | | | | | | | | | |
| 150 | N/A | С | Very Heavy | Per CPA | | | | | | |


Notes-

For SI: 1 pound per square foot = 0.0479 kPa, 1 mile per hour = 0.447 m/s.


- a. See Table R301.2.1
- b. See Table R301.2.1
- c. See Table R301.2.1
- d. See Figures R301.2(2), R301.2(4), and R301.2(6).



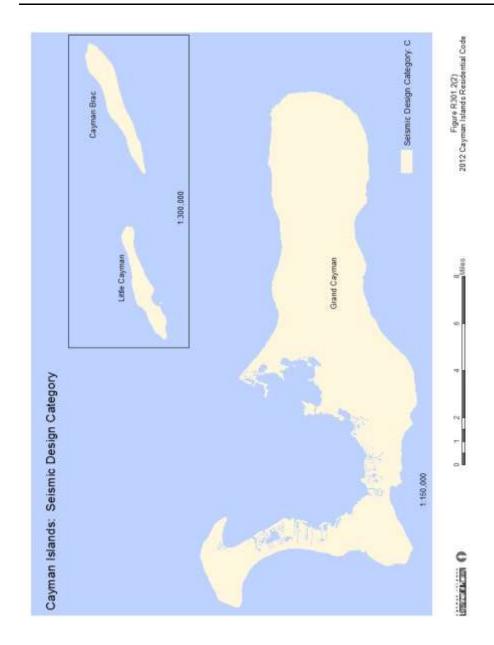

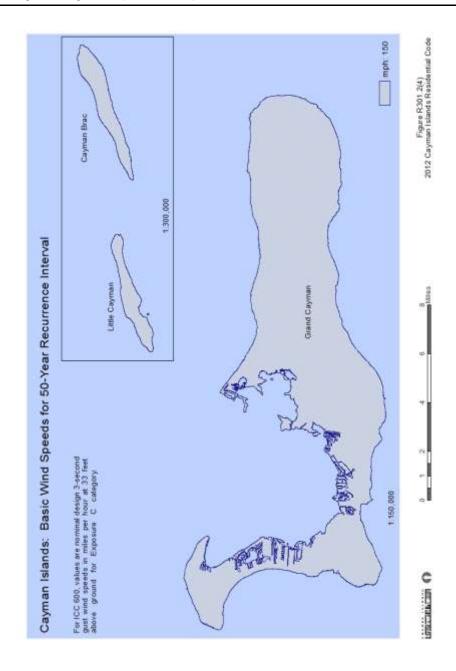



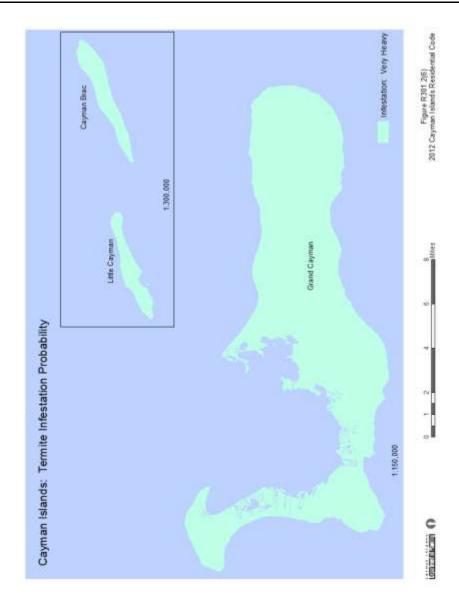



| | | | | | E R502.3.1 | • | | | | | |
|----------|-------------------|-----|-------------|------------|--------------|-------------|----------------|-----------|-------------|----------|--|
| | | | LOOR JOIS | | | | | | | | |
| | 1 | (Re | sidential S | leeping Ar | eas, Live Lo | oad = 30 ps | f, L/^ = 360) | | | | |
| | | | | | | | | | | | |
| JOIST | | | | DEAD LO | AD = 10 Dsf | | | DEAD LOAI | ND = 20 Dcf | | |
| SPACING | SPECIES AND GR | ADE | 2x6 | 2x8 | 2x10 | 2x12 | 2x6 | 2x8 | 2x10 | 2x12 | |
| (inches) | | | | | | | loor joist spa | | | | |
| | | | (ft in.) | (ft in.) | (ft in.) | (ft in.) | (ft in.) | (ft in.) | (ft in.) | (ft in.) | |
| | Douglas Fir-Larch | SS | 12-6 | 16-6 | 21-0 | 25-7 | 12-6 | 16-6 | 21-0 | 25-7 | |
| | Douglas Fir-Larch | #1 | 12-0 | 15-10 | 20-3 | 24-8 | 12-0 | 15-7 | 19-0 | 22-0 | |
| | Douglas Fir-Larch | #2 | 11-10 | 15-7 | 19-10 | 23-0 | 11-6 | 14-7 | 17-9 | 20-7 | |
| | Douglas Fir-Larch | #3 | 9-8 | 12-4 | 15-0 | 17-5 | 8-8 | 11-0 | 13-5 | 15-7 | |
| | Hem-Fir | SS | 11-10 | 15-7 | 19-10 | 24-2 | 11-10 | 15-7 | 19-10 | 24-2 | |
| | Hem-Fir | #1 | 11-7 | 15-3 | 19-5 | 23-7 | 11-7 | 15-2 | 18-6 | 21-6 | |
| | Hem-Fir | #2 | 11-0 | 14-6 | 18-6 | 22-6 | 11-0 | 14-4 | 17-6 | 20-4 | |
| 12 | Hem-Fir | #3 | 9-8 | 12-4 | 15-0 | 17-5 | 8-8 | 11-0 | 13-5 | 15-7 | |
| 12 | Southern Pine | SS | 12-3 | 16-2 | 20-8 | 25-1 | 12-3 | 16-2 | 20-8 | 25-1 | |
| | Southern Pine | #1 | 11-10 | 15-7 | 19-10 | 24-2 | 11-10 | 15-7 | 18-7 | 22-0 | |
| | Southern Pine | #2 | 11-3 | 14-11 | 18-1 | 21-4 | 10-9 | 13-8 | 16-2 | 19-1 | |
| | Southern Pine | #3 | 9-2 | 11-6 | 14-0 | 16-6 | 8-2 | 10-3 | 12-6 | 14-9 | |
| | Spruce-Pine-Fir | SS | 11-7 | 15-3 | 19-5 | 23-7 | 11-7 | 15-3 | 12-6 | 23-7 | |
| | Spruce-Pine-Fir | #1 | 11-3 | 14-11 | 19-0 | 23-0 | 11-3 | 14-7 | 17-9 | 20-7 | |
| | Spruce-Pine-Fir | #2 | 11-3 | 14-11 | 19-0 | 23-0 | 11-3 | 14-7 | 17-9 | 20-7 | |
| | Spruce-Pine-Fir | #3 | 9-8 | 12-4 | 15-0 | 17-5 | 8-8 | 11-0 | 13-5 | 15-7 | |
| | Douglas Fir-Larch | SS | 11-4 | 15-0 | 19-1 | 23-3 | 11-4 | 15-0 | 19-1 | 23-0 | |
| | Douglas Fir-Larch | #1 | 10-11 | 14-5 | 18-5 | 21-4 | 10-8 | 13-6 | 16-5 | 19-1 | |
| | Douglas Fir-Larch | #2 | 10-9 | 14-1 | 17-2 | 19-11 | 9-11 | 12-7 | 15-5 | 17-10 | |
| | Douglas Fir-Larch | #3 | 8-5 | 10-8 | 13-0 | 15-1 | 7-6 | 9-6 | 11-8 | 13-6 | |
| | Hem-Fir | SS | 10-9 | 14-2 | 18-0 | 21-11 | 10-9 | 14-2 | 18-0 | 21-11 | |
| | Hem-Fir | #1 | 10-6 | 13-10 | 17-8 | 20-9 | 10-4 | 13-1 | 16-0 | 18-7 | |
| | Hem-Fir | #2 | 10-0 | 13-2 | 16-10 | 19-8 | 9-10 | 12-5 | 15-2 | 17-7 | |
| 16 | Hem-Fir | #3 | 8-5 | 10-8 | 13-0 | 15-1 | 7-6 | 9-6 | 11-8 | 13-6 | |
| 10 | Southern Pine | SS | 11-2 | 14-8 | 18-9 | 22-10 | 11-2 | 14-8 | 18-9 | 22-10 | |
| | Southern Pine | #1 | 10-9 | 14-2 | 18-0 | 21-4 | 10-9 | 13-9 | 16-1 | 19-1 | |
| | Southern Pine | #2 | 10-3 | 13-3 | 15-8 | 18-6 | 9-4 | 11-10 | 14-0 | 16-6 | |
| | Southern Pine | #3 | 7-11 | 10-10 | 12-1 | 14-4 | 7-1 | 8-11 | 10-10 | 12-10 | |
| | Spruce-Pine-Fir | SS | 10-6 | 13-10 | 17-8 | 21-6 | 10-6 | 13-10 | 17-8 | 21-4 | |
| | Spruce-Pine-Fir | #1 | 10-3 | 13-6 | 17-2 | 19-11 | 9-11 | 12-7 | 15-5 | 17-10 | |
| | Spruce-Pine-Fir | #2 | 10-3 | 13-6 | 17-2 | 19-11 | 9-11 | 12-7 | 15-5 | 17-10 | |
| | Spruce-Pine-Fir | #3 | 8-5 | 10-8 | 13-0 | 15-1 | 7-6 | 9-6 | 11-8 | 13-6 | |



TABLE R502.3.1(1)

FLOOR JOIST SPANS FOR COMMON LUMBER SPECIES
(Residential Sleeping Areas, Live Load = 30 psf, L/^ = 360)

| JOIST | | | | DEAD LOA | AD = 10 Dsf | | | DEAD LOA | AD = 20 Dsf | |
|----------|---------------|-------|----------|----------|-------------|------------|-------------|----------|-------------|----------|
| | SPECIES AND | GRADE | 2x6 | 2x8 | 2x10 | 2x12 | 2x6 | 2x8 | 2x10 | 2x12 |
| (inches) | | | | | Ma | aximum flo | or joist sp | ans | | |
| | | | (ft in.) | (ft in.) | (ft in.) | (ft in.) | (ft in.) | (ft in.) | (ft in.) | (ft in.) |
| | Douglas Fi SS | | 10-8 | 14-1 | 18-0 | 21-10 | 10-8 | 14-1 | 18-0 | 21-0 |
| | Douglas Fi #1 | | 10-4 | 13-7 | 16-9 | 19-6 | 9-8 | 12-4 | 15-0 | 17-5 |
| | Douglas Fi #2 | | 10-1 | 12-10 | 15-8 | 18-3 | 9-1 | 11-6 | 14-1 | 16-3 |
| | Douglas Fi #3 | | 7-8 | 9-9 | 11-10 | 13-9 | 6-10 | 8-8 | 10-7 | 12-4 |
| | Hem-Fir SS | | 10-1 | 13-4 | 17-0 | 20-8 | 10-1 | 13-4 | 17-0 | 20-7 |
| | Hem-Fir #1 | | 9-10 | 13-0 | 16-4 | 19-0 | 9-6 | 12-0 | 14-8 | 17-0 |
| | Hem-Fir #2 | | 9-5 | 12-5 | 15-6 | 17-1 | 8-11 | 11-4 | 13-10 | 16-1 |
| 19.2 | Hem-Fir #3 | | 7-8 | 9-9 | 11-10 | 13-9 | 6-10 | 8-8 | 10-7 | 12-4 |
| 15.2 | Southern SS | | 10-6 | 13-10 | 17-8 | 21-6 | 10-6 | 13-10 | 17-8 | 21-6 |
| | Southern #1 | | 10-1 | 13-4 | 16-5 | 19-6 | 9-11 | 12-7 | 14-8 | 17-5 |
| | Southern #2 | | 9-6 | 21-1 | 14-4 | 16-10 | 8-6 | 10-10 | 12-10 | 15-1 |
| | Southern #3 | | 7-3 | 9-1 | 11-0 | 13-1 | 6-5 | 8-2 | 9-10 | 11-8 |
| | Spruce-Pi SS | | 9-10 | 13-0 | 16-7 | 20-2 | 9-10 | 13-0 | 16-7 | 19-6 |
| | Spruce-Pii #1 | | 9-8 | 12-9 | 15-8 | 18-3 | 9-1 | 11-6 | 14-1 | 16-3 |
| | Spruce-Pii #2 | | 9-8 | 12-9 | 15-8 | 18-3 | 9-1 | 11-6 | 14-1 | 16-3 |
| | Spruce-Pii #3 | | 7-8 | 9-9 | 11-10 | 13-9 | 6-10 | 8-8 | 10-7 | 12-4 |
| | Douglas Fi SS | | 9-11 | 13-1 | 16-8 | 20-3 | 9-11 | 13-1 | 16-2 | 18-9 |
| | Douglas Fi #1 | | 9-7 | 12-4 | 15-0 | 17-5 | 8-8 | 11-0 | 13-5 | 15-7 |
| | Douglas Fi #2 | | 9-1 | 11-6 | 14-1 | 16-3 | 8-1 | 10-3 | 12-7 | 14-7 |
| | Douglas Fi #3 | | 6-10 | 8-8 | 10-7 | 12-4 | 6-2 | 7-9 | 9-6 | 11-0 |
| | Hem-Fir SS | | 9-4 | 12-4 | 15-9 | 19-2 | 9-4 | 12-4 | 15-9 | 18-5 |
| | Hem-Fir #1 | | 9-2 | 12-0 | 14-8 | 17-0 | 8-6 | 10-9 | 13-1 | 15-2 |
| | Hem-Fir #2 | | 8-9 | 11-4 | 13-10 | 16-1 | 8-0 | 10-2 | 12-5 | 14-4 |
| 24 | Hem-Fir #3 | | 6-10 | 8-8 | 10-7 | 12-4 | 6-2 | 7-9 | 9-6 | 11-0 |
| | Southern SS | | 9-9 | 12-10 | 16-5 | 19-11 | 9-9 | 12-10 | 16-5 | 19-8 |
| | Southern #1 | | 9-4 | 12-4 | 14-8 | 17-5 | 8-10 | 11-3 | 13-1 | 15-7 |
| | Southern #2 | | 8-6 | 10-10 | 12-10 | 15-1 | 7-7 | 9-8 | 11-5 | 13-6 |
| | Southern #3 | | 6-5 | 8-2 | 9-10 | 11-8 | 5-9 | 7-3 | 8-10 | 10-5 |
| | Spruce-Pi SS | | 9-2 | 12-1 | 15-5 | 18-9 | 9-2 | 12-1 | 15-0 | 17-5 |
| | Spruce-Pii #1 | | 8-11 | 11-6 | 14-1 | 16-3 | 8-1 | 10-3 | 12-7 | 14-7 |
| | Spruce-Pii #2 | | 8-11 | 11-6 | 14-1 | 16-3 | 8-1 | 10-3 | 12-7 | 14-7 |
| | Spruce-Pii#3 | | 6-10 | 8-8 | 10-7 | 12-4 | 6-2 | 7-9 | 9-6 | 11-0 |

Check sources for availability of lumber in lengths greater than 20 feet for SI: 1 inch = 25.4 mm, 1 foot = 304.8 mm, 1 pound per square foot = 47.8 N/m^2



TABLE R802.4(1)
CEILING JOIST SPANS FOR COMMON LUMBER SPECIES
(Uninhabitable attics without storage, live load = 10 psf, L/Δ = 240)

| | 1 | | | DEAD LO | AD = 5 psf | | | | |
|-----------------------------------|-------------------|-----|-----------------------------|--------------------|--------------------|---------|--|--|--|
| CEILING TOIRT | SPECIES ANI | . 1 | 2×4 | 2×6 | 2×8 | 2 × 10 | | | |
| CEILING JOIST SPACING (inches) | GRADE | 20 | Maximum ceiling joist spans | | | | | | |
| ar Auting (inches) | GRADE | | (feet - inches) | (feet - inches) | (feet - inches) | (feet - | | | |
| | Douglas fir-larch | SS | 13-2 | 20-8 | Note a | Note a | | | |
| | Douglas fir-larch | #1 | 12-8 | 19-11 | Note a | Note a | | | |
| | Douglas fir-larch | #2 | 12-5 | 19-6 | 25-8 | Note a | | | |
| | Douglas fir-larch | #3 | 10-10 | 15-10 | 20-1 | 24-6 | | | |
| | Hem-fir | SS | 12-5 | 19-6 | 25-8 | Note a | | | |
| | Hem-fir | #1 | 12-2 | 19-1 | 25-2 | Note a | | | |
| | Hem-fir | #2 | 11-7 | 18-2 | 24-0 | Note a | | | |
| 800 | Hemfir | #3 | 10-10 | 15-10 | 20-1 | 24-6 | | | |
| 32 | Southern pine | 88 | 12-11 | 20-3 | Note a | Note a | | | |
| | Southern pine | #1 | 12-8 | 19-11 | Note a | Note a | | | |
| | Southern pine | #2 | 11-10 | 19-6 | 25-8 | Note a | | | |
| | Southern pine | M3 | 11-6 | 17-0 | 21-8 | 25-7 | | | |
| | Spruce-pine-fir | SS | 12-2 | 19-1 | 25-2 | Note a | | | |
| | Spruce-pine-fir | #1 | 11-10 | 18-8 | 24.7 | Note a | | | |
| | Spruce-pine-fir | WZ: | 11-10 | 18-8 | 24-7 | Note a | | | |
| | Spruce-pine-fir | W3 | 10-10 | 15-10 | 20-1 | 24-6 | | | |
| | Douglas fir-larch | SS | 11-11 | 18-9 | 24-8 | Note a | | | |
| | Douglas fir-larch | #1 | 11-6 | 18-1 | 23-10 | Note a | | | |
| | Douglas fir-larch | W2 | 11-3 | 17-8 | 23-0 | Note a | | | |
| | Douglas fir-larch | #3 | 9-5 | 13-9 | 17-5 | 21-3 | | | |
| | Hem-fir | SS | 11-3 | 17-8 | 23-4 | Note a | | | |
| | Hem-fir | #1 | 11-0 | 17-4 | 22-10 | Note a | | | |
| | Hem-fir | #2 | 10-6 | 16-6 | 21-9 | Note a | | | |
| 18 | Hem-fir | #3 | 9-5 | 13-9 | 17-5 | 21-3 | | | |
| P. C. | Southern pine | 58 | 11-9 | 18-5 | 24-3 | Note a | | | |
| | Southern pine | #1 | 11-6 | 18-1 | 23-1 | Note a | | | |
| | Southern pine | #2 | 10-9 | 17-8 | 23-4 | Note a | | | |
| | Southern pine | #3 | 10-0 | 14-9 | 18-9 | 22-2 | | | |
| | Spruce-pine-fir | SS | 11-0 | 17-4 | 22-10 | Note a | | | |
| | Spruce-pine-fir | #1 | 10-9 | 16-11 | 22-4 | Note a | | | |
| | Spruce-pine-fir | W2 | 10-9 | 16-11 | 22-4 | Note a | | | |
| | Spruce-pine-fir | #3 | 9-5 | 13-9 | 17-5 | 21-3 | | | |

(continued)

377



TABLE R802.4(1)—continued CEILING JOIST SPANS FOR COMMON LUMBER SPECIES (Uninhabitable attics without storage, live load = 10 psf, L/ Δ = 240)

| | | 10 | - V | DEAD LO | AD = 5 psf | |
|------------------|-------------------|-----|--------------------|--------------------|--------------------|---------|
| CEILING JOIST | SPECIES AN | , 1 | 2×4 | 2×6 | 2×8 | 2 × 10 |
| SPACING (inches) | GRADE | ં | | | ing joist span | |
| | 2010/9/10/10 | | (feet - inches) | (feet - inches) | (feet - inches) | (feet - |
| | Douglas fir-larch | SS | 11-3 | 17-8 | 23-3 | Note a |
| | Douglas fir-larch | #1 | 10-10 | 17-0 | 22-5 | Note a |
| | Douglas fir-larch | #2 | 10-7 | 16-7 | 21-0 | 25-8 |
| | Douglas fir-larch | #3 | 8-7 | 12-6 | 15-10 | 19-5 |
| | Hem-fir | SS | 10-7 | 16-8 | 21-11 | Note a |
| | Hem-fir | #1 | 10-4 | 16-4 | 21-6 | Note a |
| | Hem-fir | #2 | 9-11 | 15-7 | 20-6 | 25-3 |
| 244 | Hem-fir | #3 | 8-7 | 12-6 | 15-10 | 19-5 |
| 19.2 | Southern -pine | SS | 11-0 | 17-4 | 22-10 | Note a |
| | Southern pine | W1 | 10-10 | 17-0 | 22-5 | Note a |
| | Southern pine | #2 | 10-2 | 16-8 | 21-11 | Note a |
| | Southern pine | #3 | 9-1 | 13-6 | 17-2 | 20-3 |
| | Spruce-pine-fir | SS | 10-4 | 16-4 | 21-6 | Note a |
| | Spruce-pine-fir | #1 | 10-2 | 15-11 | 21-0 | 25-8 |
| | Spruce-pine-fir | #2 | 10-2 | 15-11 | 21-0 | 25-8 |
| | Spruce-pine-fir | #3 | 8-7 | 12-6 | 15-10 | 19-5 |
| | Douglas fir-larch | SS | 10-5 | 16-4 | 21-7 | Note a |
| | Douglas fir-larch | #1 | 10-0 | 15-9 | 20-1 | 24-6 |
| | Douglas fir-larch | W2 | 9-10 | 14-10 | 18-9 | 22-11 |
| | Douglas fir-larch | M3 | 7-8 | 11-2 | 14-2 | 17-4 |
| | Hem-fir | 88 | B-10 | 15-6 | 20-5 | Note a |
| | Hem-fir | #1 | 9-8 | 15-2 | 19-7 | 23-11 |
| | Hem-fir | #2 | 9-2 | 14-5 | 18-6 | 22-7 |
| 24 | Hem-fir | #3 | 7-8 | 11-2 | 14-2 | 17-4 |
| 24 | Southern pine | SS | 10-3 | 16-1 | 21-2 | Note a |
| | Southern pine | #1 | 10-0 | 15-9 | 20-10 | Note a |
| | Southern pine | #2 | 9-5 | 15-6 | 20-1 | 23-11 |
| | Southern pine | #3 | 8-2 | 12-0 | 15-4 | 18-1 |
| | Spruce-pine-fir | SS | 9-8 | 15-2 | 19-11 | 25-5 |
| | Spruce-pine-fir | #1 | 9-5 | 14-9 | 18-9 | 22-11 |
| | Spruce-pine-fir | #2 | 9-5 | 14-9 | 18-9 | 22-11 |
| | Spruce-pine-fir | #3 | 7-8 | 11-2 | 14-2 | 17-4 |

Check sources for availability of lumber in lengths greater than 20 feet.
For St. 1 inch = 25.4 mm, 1 foot = 304.6 mm, 1 pound per square foot = 0.0479kPa.
a. Span exceeds 26 feet in length.

378



TABLE R802.4(2) CEILING JOIST SPANS FOR COMMON LUMBER SPECIES (Uninhabitable attics with limited storage, live load = 20 psf, $U\Delta$ = 240)

| | 19 | - 8 | carmidit it | DEAD LOA | AD = 10 psf | u 93503990 |
|-------------------|-------------------|-----|--------------------|--------------------|--------------------|------------|
| CEILING JOIST | SPECIES ANI | . 1 | 2 × 4 | 2×6 | 2×8 | 2 × 10 |
| SPACING (inches) | GRADE | | | Aaximum ceil | ing joist span | 5 |
| aracina (inclies) | GRADE | | (feet - inches) | (feet - inches) | (feet - inches) | (feet - |
| | Douglas fir-tarch | SS | 10-5 | 16-4 | 21-7 | Note a |
| | Douglas fir-tarch | #1 | 10-0 | 15-9 | 20-1 | 24-6 |
| | Douglas fir-larch | #2 | B-10 | 14-10 | 18-9 | 22-11 |
| | Douglas fir-larch | #3 | 7-8 | 11-2 | 14-2 | 17-4 |
| | Hem-fir | SS | 9-10 | 15-6 | 20.5 | Note a |
| | Hem-fir | #1 | 9.8 | 15-2 | 19-7 | 23-11 |
| | Hem-fir | #2 | 9-2 | 14-5 | 18-6 | 22-7 |
| | Hem-fir | #3 | 7-8 | 11-2 | 14-2 | 17-4 |
| 12 | Southern pine | SS | 10-3 | 16-1 | 21-2 | Note s |
| | Southern pine | #1 | 10-0 | 15-9 | 20-10 | Note a |
| | Southern pine | #2 | 9-5 | 15-6 | 20-1 | 23-11 |
| | Southern pine | 63 | 8-2 | 12-0 | 15-4 | 18-1 |
| | Spruge-pine-fir | SS | 9.8 | 15-2 | 19-11 | 25-5 |
| | Spruce-pine-fir | #1 | 9-5 | 14-9 | 18-9 | 22-11 |
| | Spruce-pine-fir | #2 | 9-5 | 14-9 | 18-9 | 22-11 |
| | Spruce-pine-fir | #3 | 7-8 | 11-2 | 14-2 | 17-4 |
| | Douglas fir-larch | SS | 9-6 | 14-11 | 19-7 | 25-0 |
| | Douglas fir-larch | #1 | 9-1 | 13-9 | 17-5 | 21-3 |
| | Douglas fir-larch | 82 | 8-9 | 12-10 | 16-3 | 19-10 |
| | Douglas fir-larch | #3 | 6-8 | 9-8 | 12-4 | 15-0 |
| | Hem fir | SS | 8-11 | 14-1 | 18-6 | 23-8 |
| | Hem-fir | #1 | 8.9 | 13-5 | 16-10 | 20-8 |
| | Hem-fir | #2 | 8-4 | 12-8 | 16-0 | 19-7 |
| 4.0 | Hem-fir | #3 | 6-8 | 9-8 | 12-4 | 15-0 |
| 16 | Southern pine | SS | 9.4 | 14-7 | 19-3 | 24-7 |
| | Southern pine | #1 | 9-1 | 14-4 | 18-11 | 23-1 |
| | Southern pine | #2 | 8-7 | 13-6 | 17-5 | 20-9 |
| | Southern pine | #3 | 7-1 | 10-5 | 13-3 | 15-8 |
| | Spruce-pine-fir | SS | 8.9 | 13-9 | 18-1 | 23-1 |
| | Spruce-pine-fir | #1 | 8-7 | 12-10 | 16-3 | 19-10 |
| | Spruce-pine-fir | 02 | 8-7 | 12-10 | 16-3 | 19-10 |
| | Spruce-pine-fir | #3 | 6-8 | 9-8 | 12-4 | 15-0 |

(continued)

379



TABLE R802.4(2)-continued CEILING JOIST SPANS FOR COMMON LUMBER SPECIES (Uninhabitable attics with limited storage, live load = 20 psf, L/∆ = 240)

| | 8 | | 3-21500 11 | DEAD LOA | AD = 10 psf | | | | |
|-----------------------------------|-------------------|-----|-----------------------------|--------------------|--------------------|---------|--|--|--|
| CEILING JOIST | SPECIES ANI | | 2×4 | 2×6 | 2×8 | 2 × 10 | | | |
| CEILING JOIST SPACING (inches) | GRADE | ۱ ۲ | Maximum ceiling joist spans | | | | | | |
| | 5,555 | | (feet - inches) | (feet - inches) | (feet - inches) | (feet - | | | |
| | Douglas fir-larch | SS | 8-11 | 14-0 | 18-5 | 23-4 | | | |
| | Douglas fir-larch | #1 | 8-7 | 12-6 | 15-10 | 19-5 | | | |
| | Douglas fir-larch | #2 | 8-0 | 11-9 | 14-10 | 18-2 | | | |
| | Douglas fir-larch | 63 | 6-1 | 8-10 | 11-3 | 13-8 | | | |
| | Hem-fir | SS | 8-5 | 13-3 | 17-5 | 22-3 | | | |
| | Hem-fir | #1 | 8-3 | 12-3 | 15-6 | 18-11 | | | |
| | Hem-fir | #2 | 7-10 | 11-7 | 14-8 | 17-10 | | | |
| 40.0 | Hem-fir | #3 | 6-1 | 8-10 | 11-3 | 13-8 | | | |
| 19.2 | Southern pine | SS | 8-9 | 13-9 | 18-1 | 23-1 | | | |
| | Southern pine | #1 | 8-7 | 13-6 | 17-9 | 21-1 | | | |
| | Southern pine | #2 | 8-1 | 12-3 | 15-10 | 18-11 | | | |
| | Southern pine | #3 | 6.5 | 9-6 | 12-1 | 14.4 | | | |
| | Spruce-pine-fir | SS | 8-3 | 12-11 | 17-1 | 21-8 | | | |
| | Spruce-pine-fir | #1 | 8-0 | 11-9 | 14-10 | 16-2 | | | |
| | Spruge-pine-fir | #2 | 8-0 | 11-9 | 14-10 | 18-2 | | | |
| | Spruge-pine-fit | #3 | 6-1 | 8-10 | 11-3 | 13-8 | | | |
| | Douglas fir-larch | SS | 8-3 | 13-0 | 17-1 | 20-11 | | | |
| | Douglas fir-larch | 61 | 7-8 | 11-2 | 14-2 | 17-4 | | | |
| | Douglas fir-larch | 62 | 7-2 | 10-6 | 13-3 | 16-3 | | | |
| | Douglas fir-larch | 63 | 5-5 | 7-11 | 10-0 | 12-3 | | | |
| | Hem-fir | 55 | 7-10 | 12-3 | 16-2 | 20-6 | | | |
| | Hem-fir | #1 | 7-6 | 10-11 | 13-10 | 16-11 | | | |
| | Hem-fir | #2 | 7-1 | 10-4 | 13-1 | 16-0 | | | |
| 8200 | Hem-fir | #3 | 5-5 | 7-11 | 10-0 | 12-3 | | | |
| 24 | Southern pine | SS | 8-1 | 12-9 | 16-10 | 21-6 | | | |
| | Southern pine | #1 | 8-0 | 12-6 | 15-10 | 18-10 | | | |
| | Southern pine | #2 | 7-6 | 11-0 | 14-2 | 16-11 | | | |
| | Southern pine | #3 | 5-9 | 8-6 | 10-10 | 12-10 | | | |
| | Spruge pine fir | SS | 7-8 | 12-0 | 15-10 | 19-5 | | | |
| | Spruce pine fir | #1 | 7.2 | 10-6 | 13-3 | 16-3 | | | |
| | Spruce-pine-fir | #2 | 7-2 | 10-6 | 13-3 | 16-3 | | | |
| | Spruce-pine-fir | 03 | 5-5 | 7-11 | 10-0 | 12-3 | | | |

Check sources for availability of lumber in lengths greater than 20 feet.

For St. 1 inch = 25.4 mm, 1 foot = 304.8 mm, 1 pound per square foot = 0.0479kPa

a. Span exceeds 26 feet in length.

380



TABLE R802.5.1(1)

RAFTER SPANS FOR COMMON LUMBER SPECIES

(Roof live load=20 psf, ceiling not attached to rafters, L/Δ = 180)

| | | | 5,50-55 | DEA | = CAOL C | 10 psf | | 0.00 | DEAG | LOAD = | 20 psf | 2-1-200 |
|----------|---------------------|------------|---------|---------|----------|---------|-----------|------------|---------|---------|---------|---------|
| RAFTER | | | 2×4 | 2×6 | 2×8 | 2 × 10 | 2×12 | 2 × 4 | 2×5 | 2 × 8 | 2 × 10 | 2 × 12 |
| PACING | SPECIES AND GR | SADE | | | | | toward or | after span | 4 | | | |
| (inches) | | | ffeet - | (feet - | (feet - | (feet - | (feet - | (feet - | (feet - | (feet - | Ifeet - | ifeet - |
| | near to see the re- | C266 | inches) | inches | inches) | inches) | inches) | inches) | inches) | inches) | inches) | inches |
| | Douglasfir-larch | SS | 11-8 | 18-0 | 23-9 | Note b | Nate b | 11-6- | 18-0 | 23-5 | Note b | Note b |
| | Douglasfir-larch | #1 | 11-1 | 17-4 | 22-5 | Note b | Note b | 10-6 | 15-4 | 19-5 | 23-9 | Note b |
| | Douglasfir-larch | 62 | 10-10 | 16-7 | 21-0 | 25-8 | Note b | 9-10 | 14-4 | 18-2 | 22-3 | 25-9 |
| | Douglasfir-larch | 03 | 8.7 | 12-6 | 15-10 | 19-5 | 22-6 | 7-6 | 10-10 | 13-9 | 16-9 | 19-6 |
| | Hern-fir | 88 | 10-10 | 17-0 | 22-5 | Note b | Note b | 10-10 | 17-0 | 22-5 | Note b | Note t |
| | Hem fir | 01 | 10 -7 | 16-8 | 21-10 | Note b | Note b | 10-3 | 14-11 | 18-11 | 23-2 | Note t |
| | Hern-fit | #2 | 19-1 | 15-11 | 20-8 | 25-3 | Note b | 9-8 | 14.2 | 17-11 | 21-11 | 25-5 |
| 12 | Hem-fir | #3 | 8-7 | 12-8 | 15-10 | 19-5 | 22-6 | 7-5 | 10-10 | 13-9 | 18-9 | 19-6 |
| 14 | Southern pine | SS | 11-3 | 17-8 | 23-4 | Note b | Note b | 11-3 | 17-8 | 23-4 | Note b | Note It |
| | Southern pine | 61 | 11-1 | 17-4 | 22-11 | Note b | Note b | 10-5 | 15-6 | 19-5 | 23-2 | Note t |
| | Southern pine | 62 | 9-0 | 15-4 | 20-3 | 23-11 | Note b | 7-10 | 13-3 | 17-6 | 20-8 | Note b |
| | Southern pins | 63 | 8-3 | 12-0 | 15-3 | 18-3 | 24-1 | 7-2 | 10-4 | 13-3 | 15-10 | 20-11 |
| | Spruce-pine-fir | 88 | 10-7 | 16-8 | 21-11 | Note b | Note b | 10-7 | 16-8 | 21-9 | Note b | Note t |
| | Spruce-pine-fir | #1 | 10-4 | 16-3 | 21-0 | 25-8 | Note b | 9-10 | 14.4 | 18-2 | 22-3 | 25-9 |
| | Spruce-pine-fir | 62 | 10-4 | 16-3 | 21-0 | 25-8 | Note b | 9-10 | 14-4 | 18-2 | 22-3 | 25-9 |
| | Spruce-pine-fir | #3 | 8.7 | 12-8 | 15-10 | 19-5 | 22-6 | 7.5 | 10-10 | 13-9 | 16-9 | 19-6 |
| | Douglasfir-larch | 88 | 10-5 | 16-4 | 21-7 | Note 5 | Note b | 10-5 | 16-0 | 20-3 | 24-9 | Note t |
| | Douglasfir-larch | 61 | 10-0 | 15-4 | 19-5 | 23-9 | Note b | 9-1 | 13-3 | 16-10 | 20.7 | 23-10 |
| | Douglasfir-larch | #2 | 9-10 | 14-4 | 18-2 | 22-3 | 25.9 | 8-6 | 12-5 | 15-9 | 19-3 | 22-4 |
| | Douglasfir-larch | #3 | 7-5 | 10-10 | 13-9 | 16-9 | 19-6 | 6-5 | 9.5 | 11-11 | 14-6 | 16-10 |
| | Hemitr | 88 | 9-10 | 15-6 | 20-6 | Note b | Note b | 9-10 | 15-6 | 19-11 | 24-4 | Note t |
| | Hem-fir | 61 | 9-8 | 14-11 | 18-11 | 23-2 | Note b | 8-10 | 12-11 | 18-5 | 20-8 | 23-3 |
| | Hemfir | #2 | 9.2 | 14-2 | 17-11 | 25/11 | 25-5 | 8-5 | 12-3 | 15-6 | 18-11 | 22-0 |
| 16 | Hem-fir | #3 | 7-5 | 10-10 | 15-0 | 16-9 | 19-6 | 6-5 | 9.5 | 11-11 | 14-6 | 16-10 |
| 10 | Southern pine | SS | 10-3 | 16-1 | 21-2 | Note b | Note b | 16-3 | 16-1 | 20-0 | 25-1 | Note t |
| | Southern pine | # 1 | 10-0 | 15-9 | 19-5 | 23-2 | Note b | 9-0 | 13-5 | 16-10 | 20-0 | Note t |
| | Southern pine | #2 | 7-10 | 13-3 | 17-6 | 20-8 | Note b | 6-9 | 11-6 | 15-2 | 17-11 | 22-10 |
| | Southern pine | 03 | 7-2 | 10-4 | 13-3 | 15-10 | 20-11 | 6-2 | 9-0 | 11-6 | 13-8 | 18-1 |
| | Spruce-pine-fir | 88 | 9-8 | 15.2 | 19-11 | 25-5 | Note b | 9-8 | 14-10 | 18-10 | 23-0 | Note t |
| | Spruce-pine-fir | 01 | 9.5 | 14-4 | 18-2 | 22-3 | 25-0 | 8.6 | 12-5 | 15-9 | 19-3 | 22-4 |
| | Spruce-pine-fit | 62 | 9-5 | 14-4 | 18-2 | 22-3 | 25-9 | 5-6 | 12-5 | 15-9 | 19-3 | 22-4 |
| | Spruce-pine-fir | #3 | 7-5 | 10-10 | 13-9 | 16-9 | 19-6 | 8-5 | 9-5 | 11-11 | 14-8 | 16-10 |
| | Douglashr-larch | SS | 9-10 | 15-5 | 20.4 | 25-11 | Note b | 8-10 | 14.7 | 15-6 | 22-7 | Note t |
| | Douglashi-larch | 61 | 9-5 | 14-0 | 17-9 | 21-8 | 25-2 | 8-4 | 12-2 | 15-4 | 18-9 | 21-9 |
| | Douglasfir-larch | 62 | 8-11 | 13-1 | 16-7 | 20-3 | 23-6 | 7-9 | 11-4 | 14-4 | 17-7 | 20-4 |
| | Douglasfir-larch | 63 | 8-9 | 9-11 | 12-7 | 15-4 | 17-9 | 5-10 | 8-7 | 10-10 | 13-3 | 15-5 |
| | Hem-fir | 88 | 9-3 | 14-7 | 19-2 | 24-6 | Note b | 9-3 | 14-4 | 18-2 | 22-3 | 25-9 |
| | Hem-fir | #1 | 9-1 | 13-8 | 17.4 | 21-1 | 24-6 | 8-1 | 11-10 | 15-0 | 18-4 | 21-3 |
| | Hem-fir | 62 | 8-8 | 12-11 | 16-4 | 20-0 | 23-2 | 7-8 | 11-2 | 14-2 | 17-4 | 20-1 |
| 19.2 | Hemfit | #3 | 6.9 | 9-11 | 12-7 | 15-4 | 17-9 | 5-10 | 8.7 | 10-10 | 13-3 | 15-5 |
| 19.2 | Southern pine | 88 | 9-8 | 15-2 | 19-11 | 25-5 | Note b | 9-8 | 15-2 | 19-0 | 22-11 | Note t |
| | Southern pine | 61 | 9-5 | 14-2 | 17-9 | 21-1 | Note b | 8-3 | 12-3 | 15-4 | 18-3 | 24-4 |
| | Southern pine | 02 | 7-2 | 12-2 | 16-0 | 18-11 | 22-2 | 6-2 | 10-6 | 13-10 | 16-4 | 21-6 |
| | Southern pine | #3 | 6-6 | 9-6 | 12-1 | 14-5 | 19-1 | 5-8 | B-2 | 10-6 | 12-6 | 16-6 |
| | Spruce-pine-fit | 88 | 9.1 | 14-3 | 18-9 | 23-11 | Note b | 9-1 | 13-7 | 17-2 | 21-0 | 24.4 |
| | Spruce-pine-fir | 91 | 8-10 | 13-1 | 16-7 | 20-3 | 23-6 | 7.9 | 11-4 | 14-4 | 17-7 | 20-4 |
| | Spruce-pine-fit | 02 | 8-10 | 13-1 | 16-7 | 20-3 | 23-6 | 7-9 | 11-4 | 14-4 | 17-7 | 20-4 |
| | Spruce-pine-fir | 83 | 6.9 | 9-11 | 52-7 | 15-4 | 17-9 | 5-10 | 8-7 | 10-10 | 13-3 | 15-5 |



TABLE R802.5.1(1)—continued RAFTER SPANS FOR COMMON LUMBER SPECIES (Roof live load=20 psf, ceiling not attached to rafters, L/A = 180)

| 7 | | | Literaria-a | DEAD | LOAD = | 10 psf | Technology. | | DEAD | LOAD - | 20 psf | ramust our |
|----------|---------------------|----|--------------------|--------------------|------------|--------------------|--------------------|--------------------|--------------------|--------------------|--------------------|------------|
| RAFTER | 202:002:000 | | 2×4 | 2×6 | 2×8 | 2×10 | 2×12 | 2×4 | 2×6 | 2 * 8 | 2 × 10 | 2×12 |
| SPACING | SPECIES AN GRADE | D | | | ********** | M | aximum n | a ofter spans | | | | |
| (inches) | 250 Mes | | (feet - inches) | (feet - inches) | (feet - | (feet - inches) | (feet - |
| | Douglastir-latch | 58 | 9-1 | 14-4 | 18-10 | 23-4 | Note b | B-11 | 13-1 | 16-7 | 20-3 | 23-5 |
| | Douglasfir-larch | #1 | 8-7 | 12-8 | 15-10 | 19-5 | 22-6 | 7-5 | 10-10 | 13-9 | 16-9 | 19-8 |
| | Douglasfir-tarch | #2 | 8-0 | 11-9 | 14-10 | 18-2 | 21-0 | 8-11 | 10-2 | 12-10 | 15-8 | 18-3 |
| | Douglasfir-latch | #3 | 6-1 | 8-10 | 11/3 | 13-8 | 35-11 | 5.3 | 7-8 | 9.9 | 11-10 | 13-9 |
| | Hem-fir | 88 | 8.7 | 13-6 | 17-10 | 22-9 | Note b | 8-7 | 12-10 | 16-3 | 19-10 | 23-0 |
| | Hem-fir | #1 | 8-4 | 12-3 | 15-6 | 18-11 | 21-11 | 7-3 | 10.7 | 13-5 | 16-4 | 19-0 |
| | Hem-fir | 82 | 7-11 | 11-7 | 14-8 | 17-10 | 20-9 | 6-10 | 10-0 | 12-8 | 15-6 | 17-11 |
| 1996 | Hem-fr. | #3 | 8-1 | 8-10 | 11-3 | 13-8 | 15-11 | 5-3 | 7-8 | 9-9 | 11-10 | 13-9 |
| 24 | Southern pine | 58 | 8-11 | 14-1 | 18-6 | 23-8 | Note b | 8-11 | 13-7 | 17-0 | 20-5 | Note b |
| | Southern pine | #1 | 8-8 | 13-9 | 17-9 | 21-1 | 25-2 | 7-4 | 10-11 | 13-8 | 16-4 | 21-9 |
| | Southern pine | #2 | 6-5 | 10-10 | 14-4 | 16-11 | 19-10 | 5-6 | 9-5 | 12-5 | 14-8 | 19-3 |
| | Southern pine | #3 | 5-10 | 8-5 | 10-10 | 12-11 | 17-1 | 5-1 | 7-4 | 9-4 | 11-2 | 14-9 |
| | Spruce-pine-fir | 55 | 8.5 | 13-3 | 17-5 | 21-8 | 25-2 | 8-4 | 12.2 | 15-4 | 18-8 | 21.9 |
| | Spruce-pine-fir | #1 | 8-0 | 11-9 | 14-10 | 18-2 | 21-0 | 8-11 | 10-2 | 12-10 | 15-8 | 18-3 |
| | Spruce-pine-fir | #2 | 8-0 | 11-9 | 14-10 | 18-2 | 21-0 | 6-11 | 10-2 | 12-10 | 15-8 | 18-3 |
| | Spruce-pine-fir | #3 | 6-1 | 8-10 | 11-3 | 13-8 | 15-11 | 5.3 | 7-8 | 9.9 | 11-10 | 13-9 |

Check sources for availability of lumber in lengths greater than 20 feet.

For St. 1 inch = 25.4 mm, 1 foot = 304.6 mm, 1 pound per square foot = 0.0476 kPa.

The tabulated rather spans assume that pelling joists are located at the bottom of the attic space or that some other method of resisting the outward pash of the rathers on the bearing walls, such as rather lies, is provided at that location. When ceiling joists or rafter ties are located higher in the attic space, the rafter spans shall be multiplied by the factors given below.

| H _{e/} H _r | Rafter Span Adjustment Factor |
|--------------------------------|-------------------------------|
| 1/3 | 0.67 |
| 1/4 | 0.76 |
| 1/6 | 0.83 |
| 1/6 | 0.90 |
| 1/7.5 or less | 1.00 |

To Height of ceiling joists or rafter ties measured vertically above the top of the rafter support walls.

382



W_ = Height of roof ridge measured vertically above the top of the rafter support walls.

b. Span exceeds 25 feet in length.

TABLE R802.5.1(2) RAFTER SPANS FOR COMMON LUMBER SPECIES (Roof live load=20 psf, ceiling attached to rafters, L/∆ = 240)

| | | | | DEAD | LOAD = | 10 psf | | | DEAC | LOAD = | 20 psf | |
|----------|----------------------------------|-----------|---------|---|--------|---------|--------------|------------|-------|--------|---------|--------|
| RAFTER | | | 2×4 | 2 * 6 | 2×8 | 2 × 10 | 2×12 | 2 = 4 | 2 * 6 | 2 8 8 | 2 = 10 | 2 × 12 |
| SPACING | SPECIES AN | D | | | | W | lavimism r | offer span | a | | | |
| (inches) | 910000 | | (feet - | Moulement rafter spans (feet - (fe | | | | | | | (feet - | |
| | Douglasfir-latch | 38 | 10-5 | 16-4 | 21-7 | Note to | Note b | 10-5 | 16-4 | 21-7 | Note b | Note |
| | Douglastir-larch | #1 | 10-0 | 15-9 | 20-10 | Note b | Note b | 10-0 | 35-4 | 19-5 | 23-9 | Note |
| | Douglastir-larch | #2 | 9-10 | 15-6 | 20-5 | 25-8 | Note b | 9.10 | 14-4 | 18-2 | 22-3 | 25-9 |
| | Douglasfir-larch | 63 | 8.7 | 12-8 | 15-10 | 19-5 | 22-6 | 7.5 | 10-10 | 13.9 | 16-9 | 19-6 |
| | Hem-fr | 58 | 9-10 | 15-8 | 20-5 | Note b | Note b | 9-10 | 15-8 | 20-5 | Note b | Note |
| | Hem-tir | #1 | 9-8 | 15-2 | 19-11 | 25-5 | Note b | 9-8 | 14-11 | 18-11 | 23-2 | Note |
| | Hem-fir | #2 | 9-2 | 14-5 | 19-0 | 24-3 | Note b | 9.2 | 14-2 | 17-11 | 21-11 | 25-5 |
| 100 | Hem-fir | #3 | 8-7 | 12-8 | 15-10 | 19-5 | 22-6 | 7.5 | 10-10 | 13-9 | 18-9 | 19-6 |
| 12 | Southern pine | 88 | 10-3 | 16-1 | 21-2 | Note b | Note b | 10-3 | 16-1 | 21-2 | Note b | Note |
| | Southern pine | #1 | 10-0 | 15.9 | 20-10 | Note b | Note b | 10-0 | 15-6 | 19-5 | 23-2 | Note |
| | Southern pine | #2 | 9-5 | 15-4 | 20-3 | 23-11 | Note b | 8-9 | 13-3 | 17-6 | 20-8 | 24-1 |
| | Southern pine | #3 | 9-1 | 12-0 | 15-3 | 18-3 | 24.1 | 7-11 | 10-4 | 13-3 | 15-10 | 18-7 |
| | Spruce-pine-fir | 58 | 9-8 | 15-2 | 19-11 | 25-5 | Note b | 9-8 | 15-2 | 19-11 | 25-5 | Note |
| | Spruce-pine-fir | #1 | 9-5 | 14-9 | 19-6 | 24-10 | Note b | 9.5 | 14-4 | 18-2 | 22-3 | 25-9 |
| | Spruce-pine-fit | #2 | 9-5 | 14-9 | 19-6 | 24.10 | Note b | 9.5 | 14-4 | 18-2 | 22-3 | 25-1 |
| | Spruce-pine-fir | #3 | 8-7 | 12-6 | 15-10 | 19-5 | 22-6 | 7.5 | 10-10 | 13-9 | 16-9 | 19-6 |
| _ | Douglasfir-larch | SS | 9.6 | 14-11 | 19-7 | 25-0 | Note b | 9-6 | 14-11 | 19-7 | 24-9 | Note |
| | Douglasfir-larch | #1 | 9-1 | 14-4 | 18-11 | 23-9 | Note b | 9-1 | 13-3 | 16-10 | 20-7 | 23-1 |
| | Douglastir-larch | #2 | 8-11 | 14-1 | 18-2 | 22-3 | 25-9 | 8-6 | 12-5 | 15-9 | 19-3 | 22-4 |
| | Douglastir-tarch | #3 | 7.5 | 10-10 | 13-9 | 16.9 | 19.6 | 6.5 | 9.5 | 11-11 | 14-6 | 16-1 |
| | Hem-fir | SS | 8-11 | 14-1 | 18-8 | 23-8 | Note b | 8-11 | 14-1 | 18-6 | 23-8 | Note |
| | Hem-fir | #1 | 8-9 | 13-9 | 18-1 | 23-1 | Note b | 8-9 | 12-11 | 16-5 | 20-0 | 23-3 |
| | Hem-fr | #2 | 8-4 | 13-1 | 17-3 | 21-11 | 25-5 | 5-4 | 12-3 | 15-6 | 18-11 | 22-0 |
| | Hemitr | #3 | 7.5 | 10-10 | 13-9 | 16.9 | 19.6 | 6.5 | 9.5 | 11-11 | 14-6 | 16-1 |
| 16 | Southern pine | 58 | 9-4 | 14-7 | 19-3 | 24-7 | Note b | 9-4 | 14-7 | 19-3 | 24-7 | Note |
| | Southern pine | 61 | 9-1 | 14-4 | 18-11 | 24-1 | Note b | 9-1 | 13-6 | 16-9 | 20-0 | 23-6 |
| | Southern pine | #2 | 8-7 | 13-3 | 17-6 | 20-8 | 24-1 | 7-7 | 11-6 | 15-2 | 17-11 | 20-1 |
| | Southern pine | #3 | 7-11 | 10-4 | 13-3 | 15-10 | 18-6 | 8-10 | 9-0 | 11-6 | 13-8 | 16-2 |
| | Southern pine Spruce-pine-fir | SS | 8-9 | 13-9 | 18-1 | 23-1 | Note b | 8-9 | 13-9 | 18-1 | 23-0 | Note |
| | Spruce-prie-fir | #1 | 8-7 | 13-5 | 17-9 | 22-3 | 25-9 | 8-6 | 12-5 | 15-9 | 19-3 | 22-4 |
| | Spruce-pine-fir | #1 | 8-7 | 13-5 | 17-9 | 22-3 | 25-9 | 8-6 | 12-5 | 15-9 | 19-3 | 22-4 |
| | | #3 | 7-5 | 10-10 | 13-9 | 16-9 | 19-6 | 6.5 | 9.5 | 11-11 | 14-6 | 16-1 |
| | Spruce-pine-fit | SS | 8-11 | 14-0 | 18-5 | 23-7 | | 8-11 | 14-0 | 18-5 | 22-7 | Note: |
| | Douglasfir-larch | #1 | 8-7 | | | | Note b | 8-4 | | | | |
| | Douglasfir-larch | | 8-7 | 13-8 | 17-9 | 21-8 | 25-2 | 7-9 | 12-2 | 15-4 | 18-9 | 21-9 |
| | Douglastir-larch | #2 | | 13-1 | | 20-3 | 23-6 17-9 | 5-10 | 11.4 | 14-4 | 17-7 | 20-4 |
| 19.2 | Douglasfir-larch | | 6.9 | 9-11 | 12-7 | 15-4 | | | 8-7 | 10-10 | 13-3 | 15-5 |
| | Hem fir | 58 | 8-5 | 13-3 | 17-6 | 22-3 | Note b | 8.5 | 13-3 | 17-5 | 22-3 | 25-6 |
| | Hem-fir | #1 | 8-3 | 12-11 | 17-1 | 21-1 | 24-6 | 8-1 | 11-10 | 15-0 | 18-4 | 21-3 |
| | Hem-fir | #2 | 7-10 | 12-4 | 16-3 | 20-0 | 23-2 | 7-8 | 11-2 | 14-2 | 17-4 | 20-1 |
| | Hem-fir | #3 | 6-9 | 9.11 | 12-7 | 15-4 | 17-9 | 5-10 | 8-7 | 10-10 | 13-3 | 15-5 |

(continued)

383



TABLE R802.5.1(2)—continued RAFTER SPANS FOR COMMON LUMBER SPECIES (Roof live load=20 psf, ceiling attached to rafters, L/A = 240)

| RAFTER SPACING | | _ | 1000 | DEAD | LOAD = | 10 psf | 10000 | DEAD LOAD = 20 psf | | | | |
|-------------------|----------------------|-----|----------------------|--------------------|--------------------|--------------------|--------------------|--------------------|--------------------|--------------------|--------------------|---------|
| | SPECIES AND GRADE | | 2 * 4 | 2 * 6 | 2 * 8 | 2 × 10 | 2×12 | 2 * 4 | 2 × 6 | 2 + 8 | 2 = 10 | 2 = 12 |
| | | | Maximum rafter spans | | | | | | | | | |
| (inches) | | | (feet - inches) | (feet - inches) | (feet - inches) | (feet - inches) | (feet - inches) | (feet - | (feet - inches) | (feet - inches) | (feet - inches) | (feet - |
| | Southern pine | 55 | 8-8 | 13-8 | 18-1 | 23-1 | Note b | 8-9 | 13-9 | 18-1 | 23-1 | Note b |
| | Southern pine | #1 | 8-7 | 13-6 | 17-9 | 21-1 | 25-0 | 8-7 | 12-4 | 15-3 | 18-3 | 21-0 |
| | Southern pine | #2 | 8-0 | 12-2 | 16-0 | 18-11 | 22-0 | 6-11 | 10-6 | 13-10 | 16-4 | 19-0 |
| 19.2 | Southern pine | #3 | 7.3 | 9-6 | 12-1 | 14-5 | 17-0 | 6-3 | 9-2 | 10-6 | 12-6 | 14-8 |
| 19/5 | Spruce-pine-fir | 58 | 6-3 | 12-11 | 17-1 | 21-9 | Note b | 8-3 | 12-11 | 17-1 | 21-0 | 24-4 |
| | Spruce-pine-fir | #t | 8-1 | 12-8 | 16-7 | 20-3 | 23-6 | 7.0 | 11-4 | 14-4 | 17-7 | 20-4 |
| | Spruce-pine-fir | #2 | 8-1 | 12-8 | 16.7 | 20-3 | 23-6 | 7.9 | 11-4 | 14-4 | 17-7 | 20-4 |
| | Spruce-pine-fir | #3 | 6-9 | 9-11 | 12/7 | 15-6 | 17-9 | 5-10 | 8.7 | 10-10 | 13-3 | 15-5 |
| | Douglastir-larch | 58 | 8-3 | 13-0 | 17-2 | 21-10 | Note b | 8-3 | 13-0 | 16-7 | 20-3 | 23-5 |
| | Douglastir tarch | MI | 8-0 | 12.6 | 15-10 | 19-5 | 22-6 | 7.6 | 10-10 | 13-9 | 16-9 | 19-6 |
| | Douglasfir-larch | H2 | 7-10 | 11-9 | 14-10 | 18-2 | 21-0 | 6-11 | 10-2 | 12-10 | 15-6 | 18-3 |
| | Douglastir-larch | #3 | 6-1 | 8-10 | 11-3 | 13-8 | 15-11 | 5-3 | 7-8 | 9-9 | 11-10 | 13-9 |
| | Hem-fir | SS | 7.10 | 12-3 | 16.2 | 20-8 | 25-1 | 7-10 | 12-3 | 16-2 | 19-10 | 23-0 |
| | Hem-fit | #T | 7-8 | 12-0 | 15-6 | 18-11 | 21-11 | 7.3 | 10-7 | 13-5 | 18-4 | 19-0 |
| | Hem-fir | #2 | 7.3 | 11.5 | 14-8 | 17-10 | 20-9 | 8-10 | 10-0 | 12-8 | 15-6 | 17-11 |
| 24 | Hem4ir | #3 | 6.1 | 8-10 | 11-3 | 13-8 | 15-11 | 5-3 | 7.8 | 9.9 | 11-10 | 13-9 |
| 44 | Southern pine | 55 | 8-1 | 12-9 | 18-10 | 21-6 | Note b | 8-1 | 12-9 | 16-10 | 28-5 | 24-1 |
| | Southern pine | #t | 8-0 | 12-6 | 15-10 | 18-11 | 22-4 | 8-0 | 10-11 | 13-9 | 16-4 | 19-7 |
| | Southern pine | #2 | 7-2 | 10-10 | 14-4 | 16-11 | 19-8 | 6-2 | 9-5 | 12-5 | 14-8 | 17-0 |
| | Southern pine | #3 | 6-5 | 8-4 | 10-10 | 12-11 | 15-2 | 5-7 | 7-3 | 9-3 | 11-2 | 13-1 |
| | Spruce-pine-fir | SS | 7-8 | 12-0 | 15-10 | 20-2 | 24-7 | 7-8 | 12-0 | 15-4 | 18-9 | 21-8 |
| | Spruce-pine-fit | MT. | 7-6 | 11-9 | 14/10 | 18/2 | 21-0 | 6-11 | 10-2 | 12:10 | 15-8 | 18-3 |
| | Spruce-pine-fir | #2 | 7-0 | 11-9 | 14-10 | 18-2 | 21-0 | 6-11 | 10-2 | 12-10 | 15-8 | 18-3 |
| | Spruce-pine-fir | #3 | 6-1 | 8-10 | 11-3 | 13-8 | 15-11 | 5-3 | 7-8 | 9-0 | T1-10 | 13-9 |

Check sources for availability of lumber in lengths greater than 20 feet.

Check sources for wassansy or unreser in language greater than 30 sea.

For St. 1 inch = 25.4 mm, 1 foot = 304.8 mm, 1 pound per square foot = 0.0478 kPa.

The tabulated rather sparks assume that ceiling joints are located at the bottom of the attic space or that some other method of resisting the outward push of the rathers on the bearing walls, such as rather ties, is provided at that location. When ceiling joists or rafter ties are located higher in the aftic space, the rafter spans shall be multiplied by the factors given below:

| H ₀ /H _p | Rafter Span Adjustment Factor |
|--------------------------------|-------------------------------|
| 1/3 | 0.67 |
| 1,4 | 0.76 |
| 1/5 | 0.63 |
| 1/6 | 0.90 |
| 1/7.5 or less | 1.00 |

 H_C = Height of ceiling joists or rather ses measured vertically above the top of the rather support walls.

 H_R^2 = Height of roof ridge measured vertically above the top of the ratter support wells.


b. Span exceeds 26 feet in length.

384



Footnotes to Tables R802.5.1(1) and R802.5.1(2)

1 Tabulated rafter spans assume ceiling joists or rafter ties are located at the bottom of the attic space to resist thrust. When ceiling joists or rafter ties are located higher in the attic space, the rafter spans shall be multiplied by the factors given in the following table:



Note: Lateral deflection of the rafter below the rafter ties may exceed % inch when rafter ties are located above one-third of the ridge height, HR or when HC is greater than 2 feet and may require additional consideration.

2 Tabulated rafter spans are based on roof dead and live loads for Exposure C, rafter span adjustments shall be multiplied by 0.8.

| Three Second Gust Wind Speed (mph) | 85 | 80 | 300 | 110 | 120 | 130 | 140 | 150 | | |
|------------------------------------|--|------|------|------|------|------|------|------|--|--|
| Roof Pitch | Rafter Span Adjustment Factor for Dual-Pitched Roofs | | | | | | | | | |
| 0:12 | 1-15 | 1.10 | 0.97 | 0.87 | 0.79 | 0.73 | 0.67 | 0.62 | | |
| 1:12 | 1.17 | 1.09 | 0.97 | 0.87 | 0.79 | 0.72 | 0.67 | 0.62 | | |
| 2:12 | 1.16 | 1.08 | 0.96 | 0.86 | 0.8 | 0.72 | 0.66 | 0.63 | | |
| 3:12 | 1.34 | 1.25 | 1.10 | 0.98 | 0.89 | 0.81 | 0.75 | 0.70 | | |
| 4:12 | 1.30 | 1-21 | 1.07 | 0.96 | 0.87 | 0.79 | 0.73 | 0.68 | | |
| 5:12 | 1.24 | 1-15 | 1.02 | 0.91 | 0.63 | 0.76 | 0.70 | 0.6 | | |
| 6:12 | 1-17 | 1.09 | 0.96 | -86 | 0.78 | 0,72 | 0.66 | 0.6 | | |
| 7:12 | 1.52 | 1.41 | 1.23 | 1.09 | 0.98 | 0.00 | 0.83 | 0.7 | | |
| 8:12 | 1.42 | 1.31 | 1.15 | 1.02 | 0.92 | 0.84 | 0.78 | 0.7 | | |
| 9:12 | 1.33 | 1-22 | 1.07 | 0.95 | 0.87 | 0.70 | 0.73 | 0.6 | | |
| 10:12 | 1-22 | 1-14 | 1.00 | 0.89 | 0.81 | 0.74 | 0.66 | 0.6 | | |
| 11:12 | 1.14 | 1.06 | 0.03 | 0.84 | 0.76 | 0.69 | 0.64 | 0.5 | | |
| 12:12 | 1.06 | 30.0 | 0.87 | 0.78 | 0.71 | 0.65 | 0.6 | 0.56 | | |

3 Tabulated rafter spans shall be permitted to be multiplied by the sloped roof adjustment factors in the following table, for roof pitches greater than 4:12:

| | 20 psf Live, 10 psf Dead | 20 psf Live, 20 psf Dead |
|------------|-----------------------------|-----------------------------|
| Roof Pitch | Adjustment Facto | or for Sloped Roofs |
| 5:12 | 1.02 | 1.01 |
| 6:12 | 1.04 | 1.03 |
| 7:12 | 1.05 | 1.04 |
| 8:12 | 1.07 | 1.05 |
| 9:12 | 1.10 | 1.07 |
| 10:12 | 1.12 | 1.08 |
| 11:12 | 1.14 | 1.10 |
| 12:12 | 1.17 | 1.12 |



SCHEDULE 6

(regulation 3)

AMENDMENTS TO THE 2014 NATIONAL ELECTRICAL CODE

| Provision of the 2014 National Electrical Code affected | Exceptions, adaptations and modifications | | | |
|--|---|--|--|--|
| Article 100 Definitions | Delete the definition of "Qualified person" and substitute the following - ""Qualified person" means an electrical engineer or electrician licensed under the Electricity Act (2008 Revision).". | | | |



SCHEDULE 7

(regulation 3)

REQUIRED PERIODIC INSPECTION AND TEST INTERVALS FOR ELEVATORS AND ESCALATORS

| | | | | | | Periodic T | ests | | |
|----------------------|---|--------------------|----------|-----------------|----------|-------------|----------|--------------------|---------|
| Reference Section | | Periodic Inspe- | ctions | Category 1 | | Category 3 | | Category 5 | |
| | Equipment Type | Requirement | interval | Requirement | interval | Requirement | interval | Requirement | Interva |
| 8.11.2 | Bectric Bevators | 8.11.2.1 | 12 | 8.11.2.2 | 12 | NA. | NA | 8.11.23 | 60 |
| 8.11.3 | Hydraulic Bevalors | 8.11.3.1 | 12 | 8.11.3.2 | 12 | 8.11.3.3 | 36 | 8.11.3.4 | 60 |
| 8.11.4 | Bicalafors and moving walks | 8.11.4.1 | 12 | 8.11.4.2 | 12 | NA | NA | NA. | NA |
| 8.11.5.1 | Sidew alk elevators | 8.11.2.1, 8.11.3.1 | 12 | 8.11.22,8.11.32 | 12 | 8.11.3.3 | 36 | 8.11.2.3, 8.11.3.4 | 60 |
| 8.11.5.2 | Rivate residence elevators | 8.11.2.1, 8.11.3.1 | 36 | 8.11.22,8.11.32 | 12 | 8.11.3.3 | 36 | 8.11.23, 8.11.3.4 | 60 |
| 8.11.5.3 | Hand elevators | 8.11.2.1 | 12 | 8.11.22 | 12 | NA. | NA | 8.11.23, 8.11.3.4 | 60 |
| 8.11.5.4 | Duntswaters | 8.11.2.1, 8.11.3.1 | 12 | 8.11.22,8.11.32 | 12 | 8.11.3.3 | 36 | 8.11.2.3, 8.11.3.4 | 60 |
| 8.11.5.5 | Material Iffs and dumbw afters with | 8.11.2.1, 8.11.3.1 | 12 | 8.11.22,8.11.32 | 12 | 8.11.3.3 | 36 | 8.11.23, 8.11.3.4 | 60 |
| | automatic transfer devices | | | | | | | | |
| 8.11.5.6 | Special purpose personnel elevators | 8.11.2.1, 8.11.3.1 | 12 | 8.11.22,8.11.32 | 12 | 8.11.3.3 | 36 | 8.11.23, 8.11.3.4 | 60 |
| 8.11.5.7 | Inclined elevators | 8.11.2.1, 8.11.3.1 | 12 | 8.11.22,8.11.32 | 12 | 8.11.3.3 | 36 | 8.11.2.3, 8.11.3.4 | 60 |
| 8.11.5.8 | Shipboard elevators | 8.11.2.1, 8.11.3.1 | 12 | 8.11.22,8.11.32 | 12 | 8.11.3.3 | 36 | 8.11.23, 8.11.3.4 | 60 |
| 8.11.59 | Screw-column elevators | 8.11.2.1, 8.11.3.1 | 12 | 8.11.22,8.11.32 | 12 | 8.11.3.3 | 36 | 8.11.23, 8.11.3.4 | 60 |
| 8.11.5.10 | Rooftop elevators | 8.11.2.1, 8.11.3.1 | 12 | 8.11.22,8.11.32 | 12 | 8.11.3.3 | 36 | 8.11.23, 8.11.3.4 | 60 |
| 8.11.5.12 | Limited-use/limited-application elevators | 8.11.2.1, 8.11.3.1 | 12 | 8.11.22,8.11.32 | 12 | 8.11.3.3 | 36 | 8.11.23, 8.11.3.4 | 60 |
| 8.11.5.13 | Bevalors used for construction | 8.11.2.1, 8.11.3.1 | 3 | 8.11.22,8.11.32 | 12 | 8.11.3.3 | 36 | 8.11.23, 8.11.3.4 | 60 |

GBIEFAL NOTE: The intervals specified in this Table are required for periodic tests and inspections. Ractors such as the environment, frequency and type of usage, quality of maintenance, etc., related to the equipment were taken into account by the Cayman Islands Government. All reference sections taken from ASMEA 17.1 - 2007 Safety Code for Bevalors and Excalators.



Publication in consolidated and revised form authorised by the Cabinet this 5th day of January, 2021.

Kim Bullings Clerk of Cabinet



ENDNOTES

Table of Legislation history:

| SL# | Law # | Legislation | Commencement | Gazette |
|---------|---------|---|--------------|--------------|
| | 56/2020 | Citation of Acts of Parliament Act, 2020 | 3-Dec-2020 | LG89/2020/s1 |
| 77/2016 | | Building Code (Amendment) Regulations, 2016 | 30-Dec-2016 | G26/2016/s9 |
| | | Building Code Regulations (2013 Revision) | 11-Oct-2013 | GE82/2013/s8 |
| 59/2012 | | Building Code (Amendment) Regulations, 2012 | 19-Nov-2012 | G24/2012/s2 |
| | | Building Code Regulations (2006 Revision) | 26-Jun-2006 | G13/2006/s6 |
| 10/2005 | | Building Code (Amendment) Regulations, 2005 | 18-Apr-2005 | G8/2005/s2 |
| | | Building Code Regulations (2003 Revision) | 2-Jun-2003 | G11/2003/s3 |
| 18/2002 | | Building Code (Amendment) Regulations, 2002 | 12-Aug-2002 | G16/2002/s6 |
| | | Building Code Regulations (1998 Revision) | 17-Aug-1998 | G17/1998/s4 |
| 6/1996 | | Building Code (Amendment) Regulations, 1996 | 9-Dec-1997 | G25/1997/s2 |
| 1/1995 | | Building Code Regulations, 1995 | 29-Dec-1995 | GE21/1995/s1 |







(Price: \$14.40)

